

**GENERAL NOTES****1. GENERAL NOTES**

A. CONSTRUCTION AND DESIGNS SHALL CONFORM TO THE REQUIREMENT OF THE NATIONAL BUILDING CODE AS AMENDED, AND ANY APPLICABLE ACTS OF AUTHORITY HAVING JURISDICTION. IN CASE OF CONFLICT OR DISCREPANCY, THE MORE STRINGENT REQUIREMENTS SHALL APPLY.

B. PRIOR TO COMMENCEMENT OF ANY WORKS THE CONTRACTOR SHALL VERIFY ALL INFORMATION DIMENSIONS AND SPECIFICATIONS OUTLINED IN THIS DRAWING PACKAGE.

C. ADVISE THE BUILDER/CONTRACTOR OF ANY DISCREPANCIES OBSERVED. THE REQUIREMENT OF EXPLANATIONS MUST FOLLOW PRIOR TO CONSTRUCTION.

D. ANY VARIANCE FROM THE INFORMATION SHOWN IN THIS DRAWING PACKAGE SHALL BE REPORTED TO AND APPROVED BY THE BUILDER PRIOR TO CONSTRUCTION.

E. IT IS THE RESPONSIBILITY OF THE BUILDER TO CONTACT A PROFESSIONAL ENGINEER FOR ALL CONSTRUCTION ELEMENTS NOT IDENTIFIED BY THE NATIONAL BUILDING CODE.

F. DO NOT IMPOSE CONSTRUCTION LOADS ON THE STRUCTURE IN EXCESS OF THE DESIGN LOADS.

G. PROTECT EXISTING BUILDINGS, TREES, FENCING, UTILITY POLES, CABLES, ACTIVE UNDERGROUND SERVICES AND SPACING ON THE SITE OR ANY ADJOINING PROPERTIES FROM DAMAGE. ANY DAMAGE RESULTED FROM THIS CONSTRUCTION WORK SHALL BE MADE GOOD TO THE APPROVAL OF THE BUILDER AT NO COST TO THE OWNER.

H. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE REQUIREMENTS OF THE CONSTRUCTION SAFETY ACT (INCLUDING LATEST AMENDMENTS) AND OTHER LOCAL AUTHORITIES HAVING JURISDICTION.

**2. FOUNDATION & EXCAVATION WORK**

A. PRIOR TO COMMENCEMENT OF ANY WORKS THE CONTRACTOR SHALL VERIFY ALL INFORMATION DIMENSIONS AND SPECIFICATIONS OUTLINED IN THIS DRAWING PACKAGE.

B. EARTH BOTTOMS OF EXCAVATIONS TO BE DRY UNDISTURBED SOIL, LEVEL AND FREE FROM ANY LOOSE OR ORGANIC MATERIALS.

C. PROTECT BOTTOMS OF EXCAVATIONS FROM SOFTENING. SHOULD SOFTENING OCCUR REMOVE SOFTENED SOIL AND REPLACE WITH CONCRETE.

D. PROOF ROLL EXISTING FILL MATERIAL, REMOVE ANY LOOSE OR SOFTENED AREAS BEHIND SLAB/FOOTING BEFORE PLACEMENT OF GRANULAR FILL.

E. BACKFILL SIMULTANEOUSLY EACH SIDE OF WALL TO EQUALIZE SOIL PRESSURES. DO NOT EXCEED A GRADE DIFFERENCE OF 24" [610].

F. ALL FOUNDATIONS ARE TO BE INSTALLED ON UNDISTURBED SOIL WITH A BEARING CAPACITY OF 2000 PSF.

G. APPROVED GRANULAR FILL UNDER FOOTINGS SHALL BE COMPACTED IN 8" [203] LAYERS TO 98% S.P.D.

H. EXTEND EXTERIOR FOUNDATIONS BELOW THE FROST LINE AS NOTED ON THE FOUNDATION PLAN, CARRY UNDERSIDE OF EXTERIOR FOOTINGS DOWN A MINIMUM OF 4'-0" [1220] BELOW FINISHED GRADE.

I. PROTECT FOUNDATION INCLUDING ANY SLAB ON GRADE FROM FROST ACTION DURING CONSTRUCTION.

J. ALL CONCRETE WORK TO CONFORM TO CAN3-A438-M.

K. REINFORCING STEEL SHALL BE DEFORMED HI-BOND HARD GRADE WITH A MINIMUM YIELD STRENGTH OF 58 000 PSI.

L. LOCATE ALL FOOTINGS CENTRALLY UNDER COLUMNS AND WALL UNLESS NOTED OTHERWISE.

M. DURING COLD WEATHER CONCRETE POURS WHEN TEMPERATURES ARE BELOW 5 C, ALL CONCRETE IN THE CURING STAGES SHALL BE KEPT AT A TEMPERATURE ABOVE 10 C.

N. WATER CURING OF CONCRETE IS RECOMMENDED.

O. STEP FOOTING DOWN OR LOWER FOOTING WHERE NECESSARY TO SUIT EXISTING AND/OR ADJACENT FOOTINGS, MECHANICAL & ELECTRICAL INSTALLATIONS, AND POOR SOIL CONDITIONS. THE LINE OF SLOPE ALONG STEPPED FOOTINGS AND BETWEEN ADJACENT FOOTINGS, AND/OR EXCAVATIONS SHALL NOT EXCEED THE ANGLE OF REPOSE FO THE SITE SOIL CONDITIONS. STEP FOOTINGS 2'-0" [610] MAXIMUM AT A TIME.

P. AT LOCATIONS WHERE MECHANICAL SERVICES INTERFERE WITH FOOTINGS ESTABLISH TOP OF FOOTING A MINIMUM OF 8" [203] BELOW INVERT ELEVATION.

Q. SPACING OF CONTROL JOINTS IN CONCRETE SLABS SHALL NOT EXCEED 20'.

**3. CAST IN PLACE CONCRETE**

A. ALL CONCRETE WORK SHALL CONFORM TO CSA STANDARDS A23.1/A23.2-14.

B. CONCRETE COMPRESSIVE STRENGTH ( $f_c$ ) AT 28 DAYS SHALL BE AS FOLLOWS UNLESS NOTED OTHERWISE IN THESE DRAWINGS:

FOOTINGS 20MPa (UNLESS NOTED OTHERWISE)

WALLS & PIERS 25MPa (UNLESS NOTED OTHERWISE)

SLABS 32MPa (UNLESS NOTED OTHERWISE)

C. PROVIDE AIR-ENTRAINED CONCRETE TO ALL CONCRETE ELEMENTS EXPOSED TO WEATHER IN ACCORDANCE WITH THE REFERENCED STANDARD INCLUDING FOUNDATION WALLS.

D. SIDE OF FOOTINGS SHALL BE FORMED UNLESS SPECIFICALLY SHOWN ON THE DRAWINGS TO BE Poured AGAINST EARTH, WHERE EARTH FORMS ARE PERMITTED, HAND TRIM BOTTOM & SIDES AND REMOVE ALL LOOSE EARTH BEFORE PLACING CONCRETE.

E. PROVIDE SLEEVES IN SLABS OR WALLS FOR MECHANICAL PIPING AND AVOID OPENINGS WHERE POSSIBLE.

F. DETAIL FABRICATE AND PLACE ALL REINFORCING IN CONFORMANCE WITH THE LATEST EDITION OF "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCING CONCRETE STRUCTURE AND METRIC SUPPLEMENT" BY THE REINFORCING STEEL INSTITUTE.

G. ALL REINFORCING BAR SHALL BE DEFORMED BARS CONFORMING TO CAN/CSA G30.18-09 WITH A MINIMUM YIELD STRENGTH OF 400MPa. WELDED FABRIC SHALL CONFORM TO CSA G30.5-M1983 WITH A MINIMUM YIELD STRENGTH OF 440MPa.

H. PROVIDE CONCRETE COVER TO REINFORCEMENT AS FOLLOWS:

SLAB ON GRADE 1 1/2" [38] FROM TOP

CONC. Poured AGAINST EARTH 3" [76]

CONC. Poured AGAINST FORMED SURFACE 2" [51]

I. MESH LAPS 12" [306]. ALL OTHER LAPS AND EMBEDMENT OF DOWELS TO BE 36x THE BAR DIAMETER OR 18" [451] MINIMUM UNLESS NOTED OTHERWISE ON THE PLANS.

J. PROVIDE DOWELS FROM ALL FOOTINGS TO REINFORCED CONCRETE WALLS, PIERS AND COLUMNS. SECURE COLUMN DOWELS IN CORRECT POSITION PRIOR TO CONCRETE PLACEMENT.

K. GROUND UNDERSIDE OF STEEL COLUMNS AND BEAM BEARING PLATES WITH DRY PACK NON-SHRINK GROUT TO MANUFACTURERS SPECIFICATIONS.

L. CONTROL JOINT FILLER TO BE SIKAFLEX OR APPROVED EQUAL.

**4. SLAB ON GRADE**

A. EXCAVATE AND REMOVE ALL FOREIGN MATERIAL AND SOFT SPOTS IN THE SUB GRADE AND PREPARE SUBGRADE AS PER THE GEOTECHNICAL REPORT.

B. PLACE GRANULAR FILL TO COVER THE ENTIRED BUILDING AREA TO A MINIMUM DEPTH OF 8" [203]. COMPACTED FILL TO 100% S.P.D. UNLESS SPECIFIED OTHERWISE IN THE GEOTECHNICAL REPORT ON DRAWINGS OR EXCAVATION SPECIFICATIONS.

C. ALL GRANULAR FILL IS TO MEET THE SPECIFIED REQUIREMENTS AS RECOMMENDED IN THE GEOTECHNICAL REPORT AND SPECIFICATIONS.

D. ALL SLAB ON GRADE TO BE PLACED ON NATURAL UNDISTURBED SOIL OR COMPACTED GRANULAR FILL CAPABLE OF SUSTAINING A MINIMUM 1000PSF [48kN/m]. ALL FILL TO BE COMPACTED TO A MINIMUM OF 100% S.P.D. UNLESS NOTED OTHERWISE.

E. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE A MINIMUM 32MPa. PROVIDE CONTROL JOINT DETAILS AROUND COLUMNS.

**5. TEMPORARY WORK**

A. PROVIDE ALL ADEQUATE SHORING FOR THE SAFE COMPLETION OF THE WORK. ASSUME RESPONSIBILITY TO DESIGN AS WELL AS TO ERECT, MAINTAIN AND EVENTUALLY REMOVE ALL THE TEMPORARY WORKS NECESSARY FOR CARRYING OUT OF THIS CONTRACT.

B. MAKE ADEQUATE PROVISIONS FOR CONSTRUCTION STRESSES AND FOR SUFFICIENT TEMPORARY BRACING TO KEEP THE STRUCTURE PLUMB AND IN THE TRUE ALIGNMENT AT ALL PHASES OF WORK UNTIL COMPLETION (INCLUDING MASONRY WALLS, FLOOR AND ROOF DECKS, ETC.). ANY BRACING MEMBERS SHOWN ON PLANS ARE THOSE REQUIRED FOR THE FINISHED STRUCTURE AND MAY NOT BE SUFFICIENT FOR ERECTION PURPOSES.

**C. TRUCKS, CRANES, HOISTS OR ANY HEAVY EQUIPMENT OR MATERIALS**

ARE NOT ALLOWED TO ENTER ANY STRUCTURAL FLOOR OR ROOF AREA UNLESS SPECIFICALLY DESIGNED AND DESIGNATED FOR THIS PURPOSE.

D. THE CONTRACTOR SHALL HAVE THE SOLE RESPONSIBILITY FOR THE DESIGN, ERECTION, OPERATION, MAINTENANCE AND REMOVAL OF TEMPORARY SUPPORTS, TEMPORARY BRACING, SHORING SYSTEM AND FACILITIES AND THE DESIGN AND EXECUTION OF CONSTRUCTION METHODS REQUIRED IN THEIR USE.

E. THE CONTRACTOR SHALL ENGAGE AND PAY FOR REGISTERED PROFESSIONAL ENGINEERING PERSONNEL SKILLED IN THE APPROPRIATE DISCIPLINES TO PERFORM THOSE FUNCTIONS REFERRED TO IN PARAGRAPH ABOVE OR AND IN ALL CASES WHERE SUCH TEMPORARY SUPPORTS, STRUCTURES, FACILITIES AND THEIR METHOD OF CONSTRUCTION ARE OF SUCH A NATURE THAT PROFESSIONAL ENGINEERING SKILL IS REQUIRED TO PRODUCE SAFE AND SATISFACTORY RESULTS.

F. ADDITIONAL REQUIREMENTS

A. DEADBOLT REQUIRED ON ALL SWING ENTRANCE DOORS INCLUDING SECONDARY ENTRANCE DOORS PER NBC.

B. INTERIOR STAIRS MUST COMPLY WITH THE FOLLOWING RESTRICTIONS PER NBC.

MIN. RISE = 4 7/8" [125] MAX. RISE = 7 7/8" [200]  
MIN. RUN = 10" [250] MAX. RUN = 14" [355]

TREAD DEPTH MIN = 9 1/4" [235] TREAD DEPTH MAX. = 14" [355]

C. MINIMUM LANDING WIDTH TO BE SAME WIDTH AS STAIR WITH A LENGTH NO LESS THAN 35 1/2" [900]

D. HANDRAILS/GUARDS MUST COMPLY WITH THE FOLLOWING RESTRICTIONS PER NBC.

a. ALL HANDRAILS TO RESIST A MIN. CONCENTRATED LOAD OF 0.9 kN [203 LBs]  
b. HANDRAIL REQUIRED FOR INTERIOR STAIRS HAVING MORE THAN 2 RISERS  
c. HANDRAIL REQUIRED FOR EXTERIOR STAIRS HAVING MORE THAN 3 RISERS  
d. HANDRAILS INSTALLED AT A HEIGHT BETWEEN 34 1/8" [865] TO 37 7/8" [965]  
e. HANDRAIL PROJECTIONS NO MORE THAN 3 7/8" [100] INTO REQUIRED STAIR WIDTH  
f. ALL GUARDS TO BE NON-CLIMBABLE WITH NO OPENINGS TO PERMIT THE PASSAGE OF A SPHERICAL OBJECT HAVING A DIAMETER MORE THAN 3 7/8" [100] BETWEEN HEIGHTS 5 1/2" [140] TO 35 3/8" [900]  
g. GUARD HEIGHT FOR INTERIORS TO BE MIN. 35 1/2" [900]  
h. GUARD HEIGHT FOR EXTERIOR TO BE MIN. 42 1/4" [1070]

**E. GLASS IN GUARDS**

a. ALL GLASS NOTED TO BE SAFETY GLASS SHALL COMPLY TO THE REQUIREMENTS IN NBC.  
b. GLASS REQUIRED TO BE SAFETY GLASS SHALL BE HEAT STRENGTHENED LAMINATED OR APPROVED EQUAL.

F. ALL ELECTRICAL WORK TO BE COMPLETED AS PER NBC.

G. PROVIDE APPROVED DRAINAGE LAYER TO FOUNDATION WALLS BELOW GRADE.

H. ENSURE MINIMUM HEAD ROOM CLEARANCE OF 6'-5" BELOW ALL DUCTS, BULKHEADS & BEAMS.

I. PROVIDE VENTING TO EXTERIOR FOR ALL BATHROOMS & DRYERS. RANGE HOODS ARE TO BE VENTED TO EXTERIOR W/ NON-COMBUSTIBLE AND CORROSION RESISTANT DUCTWORK.

J. SMOKE DETECTORS ARE REQUIRED ON EACH FLOOR LEVEL AND IN EACH BEDROOM. THEY SHALL BE INTERCONNECTED AND HAVE A VISUAL SIGNALING COMPONENT. INTERCONNECT CARBON MONOXIDE DETECTORS ON BEDROOM FLOORS.

K. NON-LOAD BEARING WALLS PARALLEL TO THE FLOOR JOISTS SHALL BE SUPPORTED BY JOISTS BELOW THE WALL OR BLOCKING BETWEEN THE BEARING JOISTS.

L. SHEATHING TO BE GLUED AND SCREWED UNLESS NOTED OTHERWISE.

M. INTERIOR DOORS TO BE UNDERCUT 1/2" FOR ROOMS WITHOUT A RETURN AIR

N. BATHROOM WALLS SUBJECT TO DIRECT CONTACT WITH MOISTURE SHALL SUBSTITUTE GYPSUM BOARD FOR A MOISTURE RESISTANT APPROVED SUBSTRATE. COORDINATE WITH GENERAL CONTRACTOR.

**7. FRAMING NOTES**

A. ALL WOOD SHALL BE NO. 2 S-P-F OR BETTER UNLESS NOTED OTHERWISE.

B. ALL BEAMS TO BE SUPPORTED BY A COLUMN (WITH PLATE IF PERMITTED) EQUAL TO THE WIDTH OF BEAM AND BOLTS WELDED OR SCREWED TO COLUMN/PLATES TOP & BOTTOM.

C. ALL SILL PLATES SHALL BE ANCHORED TO THE FOUNDATION OR FLOOR SLAB WITH 5/8" DIA. ANCHOR BOLTS AT 4" O/C MAX.

D. MOISTURE CONTENT OF LUMBER SHALL NOT EXCEED 19% AT TIME OF INSTALLATION.

E. THE CONTRACTOR SHALL TAKE PRECAUTIONS TO NOT OVERLOAD THE STRUCTURE DURING CONSTRUCTION.

F. FRAMING CONTRACTOR TO INSTALL WIND BRACING AS REQUIRED.

G. METAL JOIST HANGERS REQUIRED FOR FLUSH MOUNT BEAMS.

H. STEEL BEAMS SHALL HAVE 3 1/2" MIN. END BEARING ON MASONRY AND 2 1/2" MIN. BEARING ON STEEL. LINTELS TO HAVE MIN. 6" BEARING UNLESS INDICATED OTHERWISE.

I. COLUMN BASE PLATES AND BEAM BEARING PLATES SHALL BE GROUTED WITH 1 1/2" NON-SHRINK GROUT.

J. PREFABRICATED WOOD TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH THE DETAILS AND DESIGN LOADS ON THE ARCHITECTURAL DRAWINGS. SHOP DRAWINGS OF THE ROOF TRUSSES INCLUDING LAYOUT OF THE TRUSSES, BRIDGING, BRACING AND BEARING DETAILS (INCLUDING HOLD-DOWN CLIPS) SHALL BEAR THE STAMP OF A REGISTERED PROFESSIONAL ENGINEER OF THE PROVINCE OF ONTARIO AND SHALL BE SUBMITTED TO THE DEVELOPER FOR REVIEW BEFORE FABRICATION.

K. WHERE THERE IS A VARIETY OF EXTERIOR WALL FINISHES THE ROOF OVERHANGS MAY REQUIRE ADJUSTMENT AND/OR PLATE HEIGHT ADJUSTED TO ALLOW SOFFITS TO BE FLUSH.

L. ALL RAFTERS, JOISTS & STUDS TO BE CONTINUOUS. MIN. 2 PLY AT OPENINGS. RIDGE, HIP & VALLEY RAFTERS TO BE MIN. 1" LARGER THAN RAFTER SIZE.

M. PROVIDE SOLID BLOCKING IN ALL FULL BATH TUB/SHOWER AND AT TOILET FOR FUTURE GRAB BAR INSTALLATION.

N. MIN. NAILING REQUIREMENTS TO COMPLY WITH NBC FOR SHEATHING.

**DESIGN NOTES****1. GENERAL NOTES**

A. EXAMINE ALL DRAWINGS, SPECIFICATIONS & CONTRACT DOCUMENTS TO OBTAIN ALL APPLICABLE LOADS. REPORT DISCREPANCIES TO THE CONSULTANT.

B. UNLESS NOTED OTHERWISE THE UNIT LOADS INDICATED ARE INFACORED. MEMBER FORCES GIVEN ON DRAWINGS ARE FACORED.

C. THE STRUCTURE HAS BEEN DESIGNED FOR WIND AND SNOW IN ACCORDANCE WITH THE REQUIREMENT OF THE LATEST EDITION OF THE NATIONAL BUILDING CODE.

D. FLOOR JOISTS TO BE DESIGNED FOR A DEFLECTION LIMIT OF L/360.

**2. CLIMATIC DESIGN LOADS**

A. LOCATION: DUNDALK, ONTARIO

B. BUILDING IMPORTANCE CATEGORY: NORMAL

**C. SNOW LOADING (SB-1)**

IMPORTANCE FACTOR FOR ULS: Is 1.0

IMPORTANCE FACTOR FOR SLS: Is 0.9

GROUND SNOW LOAD: Ss 3.2 kPa

1/8 ASSOCIATED RAIN LOAD: Sr 0.4 kPa

BASIC ROOF SNOW LOAD FACTOR: Cb 0.55





**D. WIND LOADS**

WIND EXPOSURE: OPEN

**E. ROOF TRUSSES**

DESIGNED AND STAMPED BY A PROFESSIONAL ENGINEER IN THE PROJECT LOCATION. SHOP DRAWINGS SHALL BE SUBMITTED AND APPROVED PRIOR TO CONSTRUCTION.

DRAWING INDEX		
ARCHITECTURAL & STRUCTURAL		
SHEET NUMBER:	SHEET NAME:	CURRENT REV.:
A0.1	GENERAL NOTES	5
A0.2	SCHEDULES	5
A1.0	PLOT PLAN	5
A2.0	FOUNDATION PLAN	5
A3.0	FLOOR PLAN	5
A3.1	ROOF PLAN	5
A3		



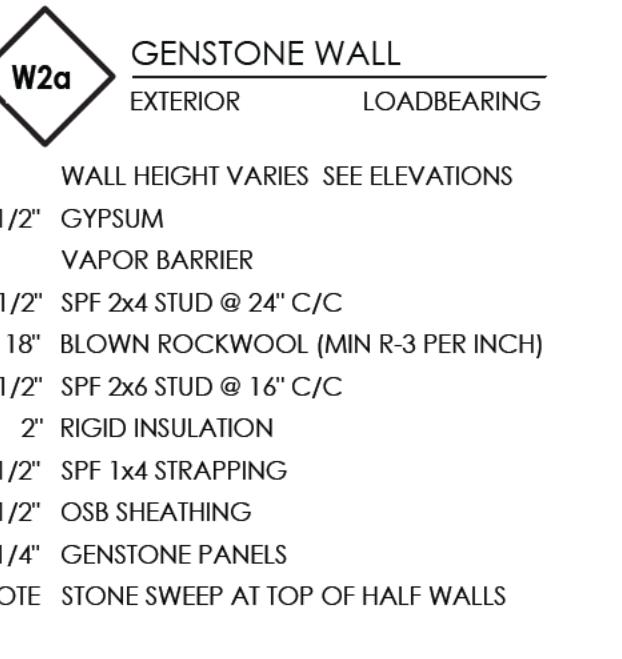
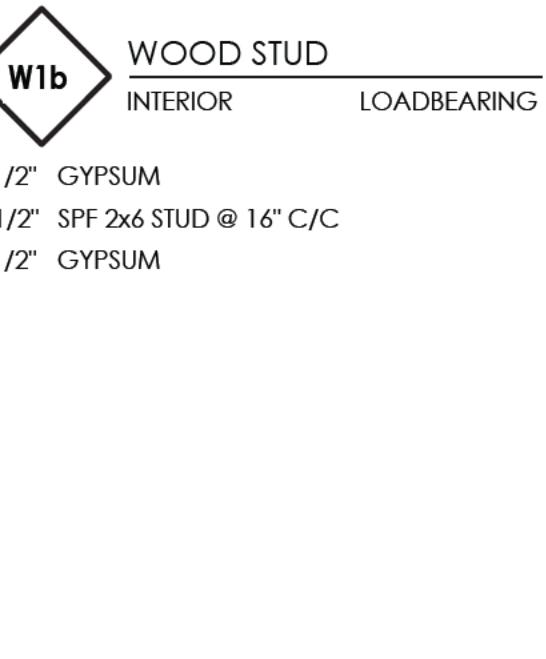
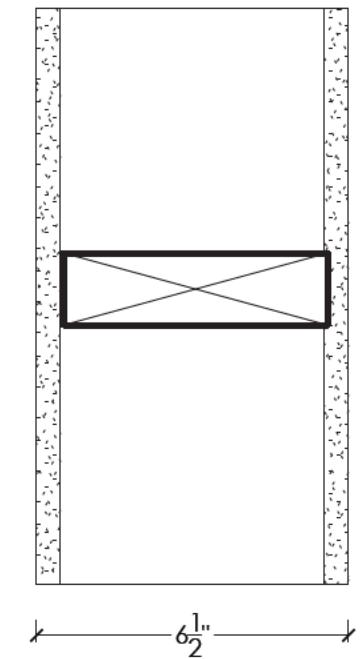
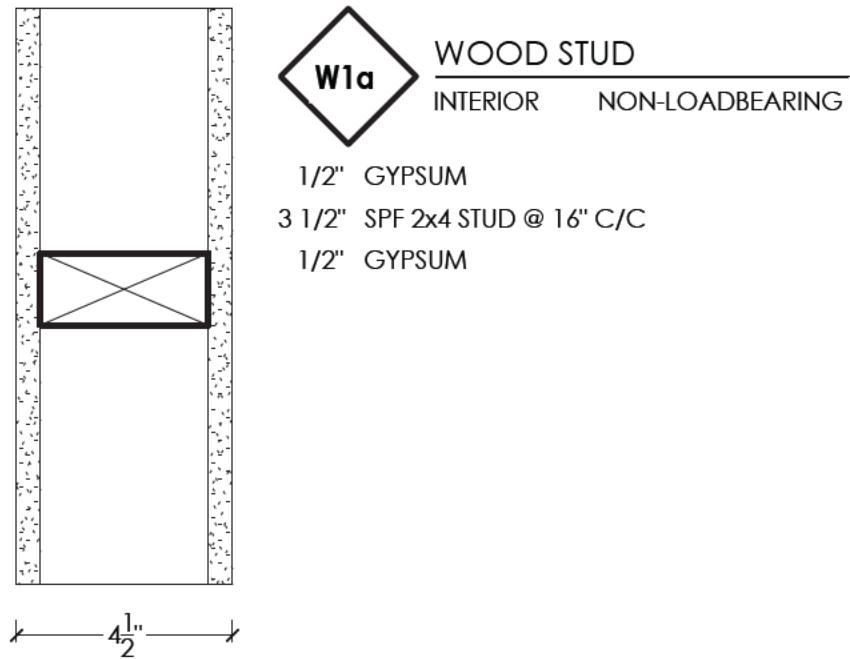


General Note:  
THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DRAWINGS, DETAILS AND SPECIFICATIONS, INCLUDING WITH ARCHITECTURAL DRAWINGS AND MUST REPORT ANY DISCREPANCIES TO THE ARCHITECT AND ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION.

THE CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF BALAN ENGINEERING CORP. THE DRAWINGS AND SPECIFICATIONS ARE FOR THE NOTED PROJECT ONLY. ANY UNAUTHORIZED USE OF THESE DRAWINGS AND SPECIFICATIONS IS PROHIBITED. WRITTEN PERMISSION OF BALAN ENGINEERING CORP IS STRICTLY PROHIBITED.

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

DO NOT SCALE DRAWINGS

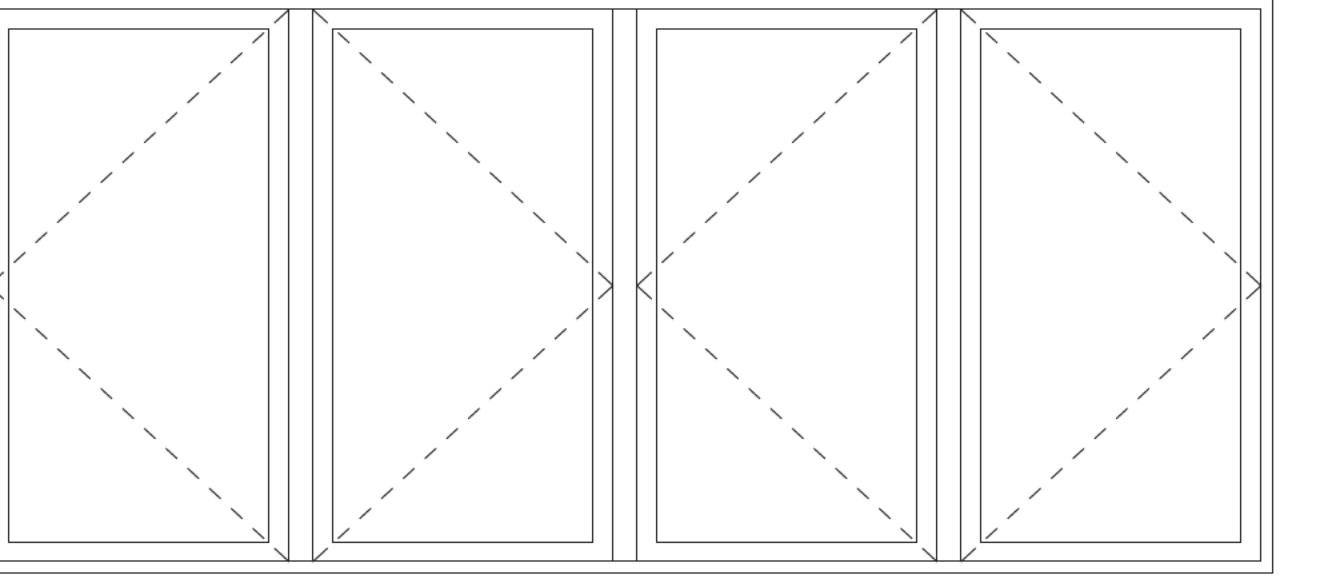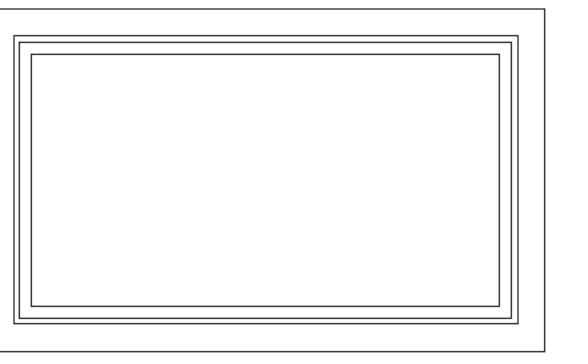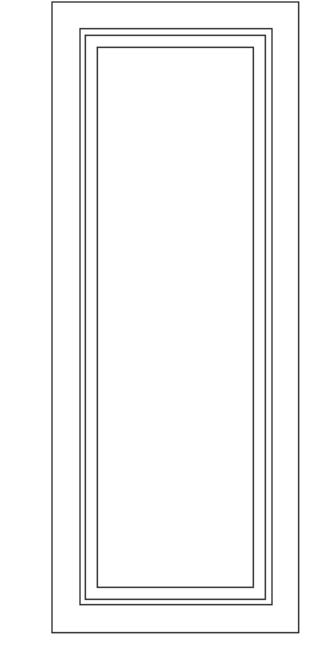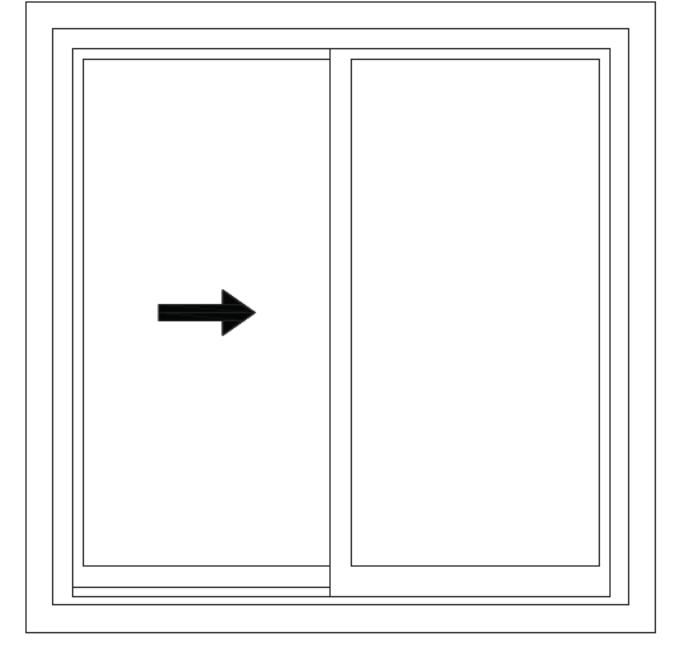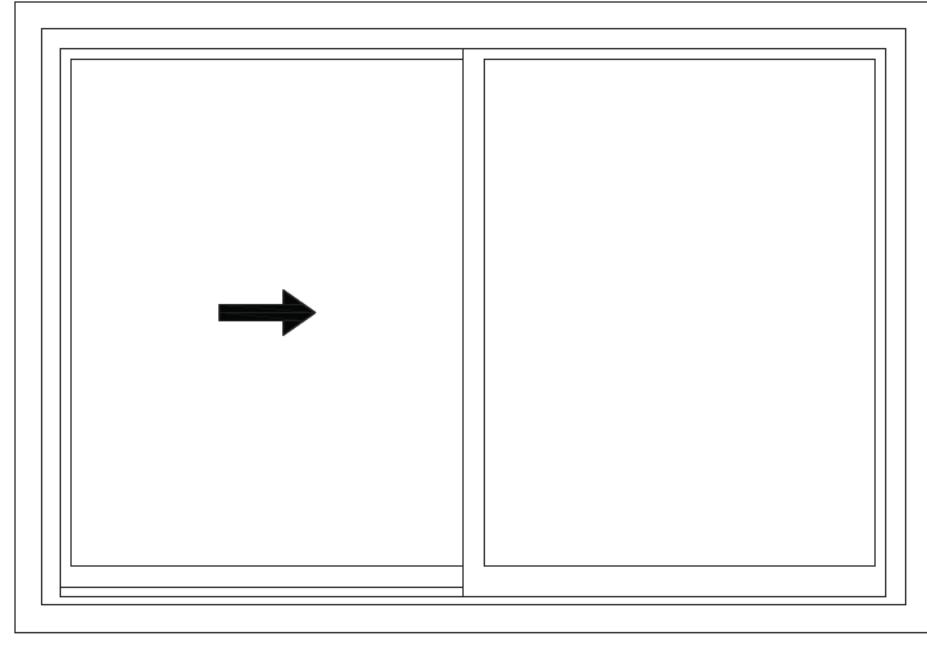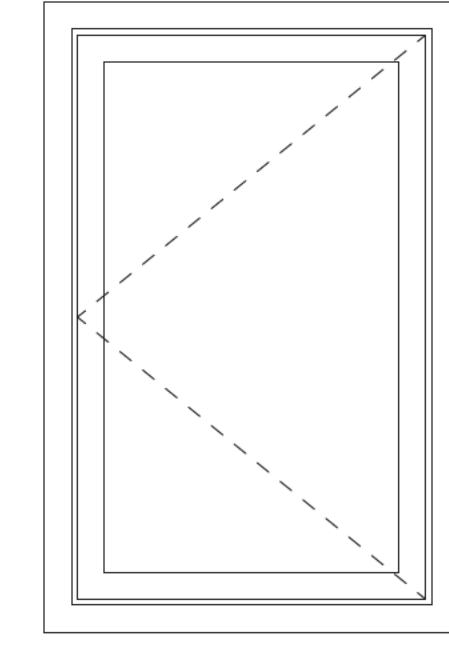

W01 30'x48" CASEMENT  
SILL HEIGHT = 42"








W02 60"x48" SLIDING  
SILL HEIGHT = 42"

W03 48"x48" SLIDING  
SILL HEIGHT = 42"

W04 16"x48" FIXED  
SILL HEIGHT = 42"

W05 42"x24" FIXED  
SILL HEIGHT = 102"

W06 108"x48" MULTI-CASEMENT \*SPECIAL ORDER\*  
SILL HEIGHT = 42"

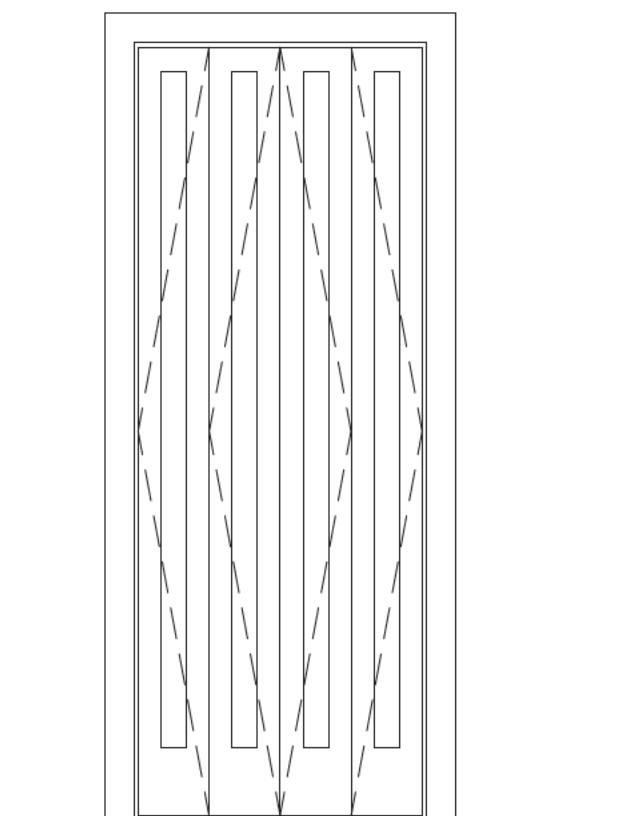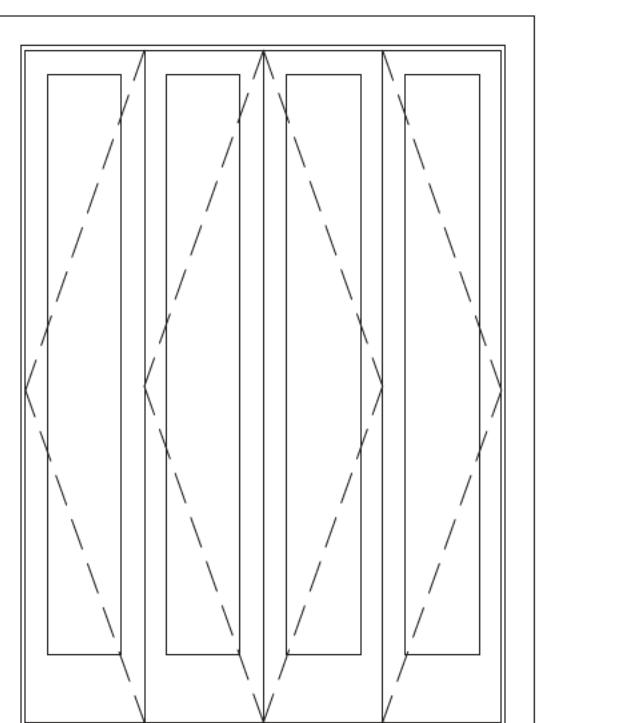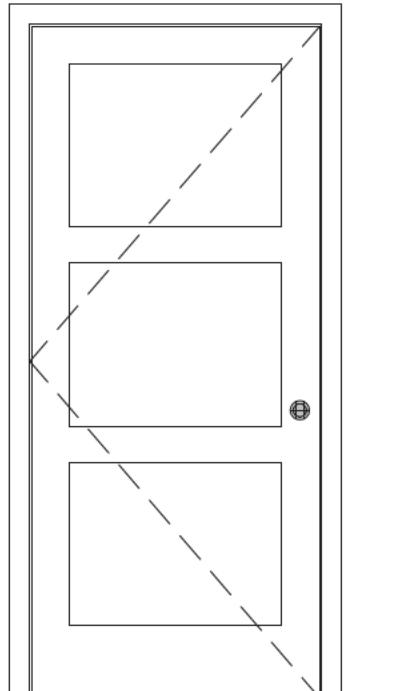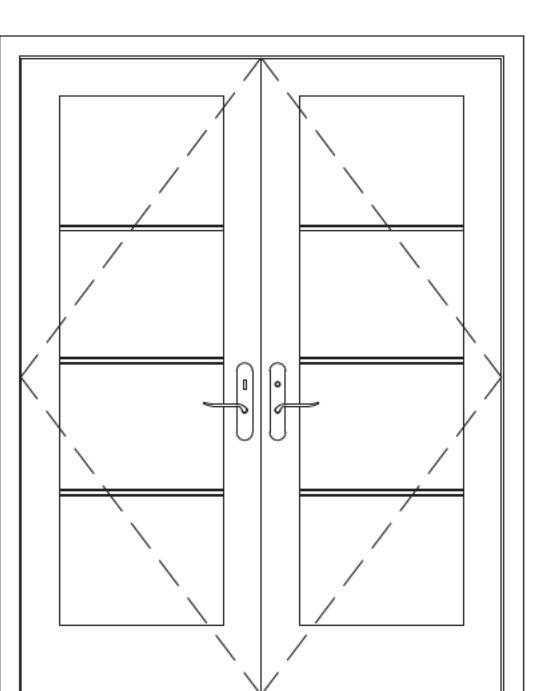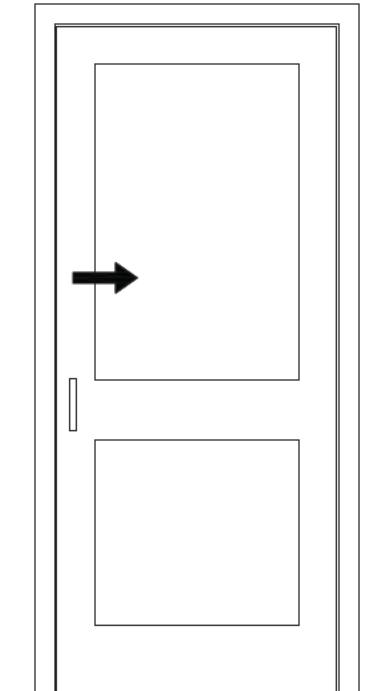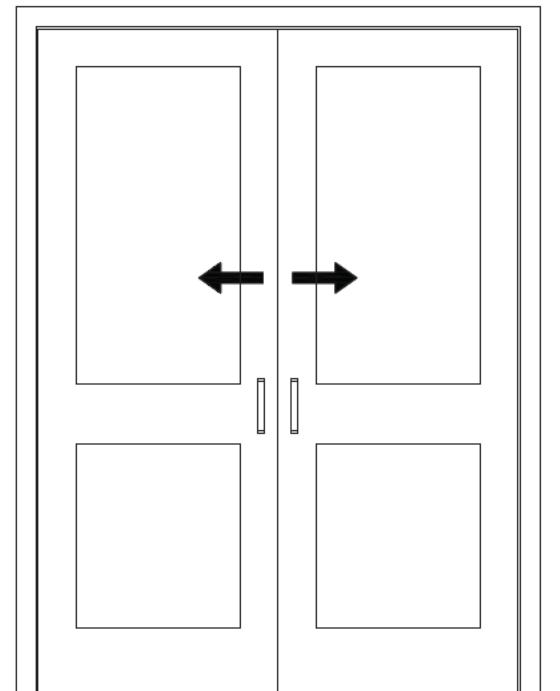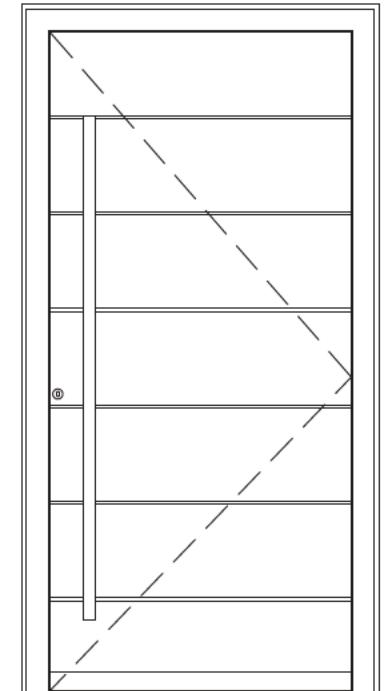

D01 44"x86" ENTRY

D02 60"x84" DOUBLE POCKET

D03 35"x84" SINGLE POCKET

D04 60"x80" FRENCH

D05 36"x84" HINGED

D06 60"x84" BI-FOLD CLOSET

D07 36"x96" BI-FOLD CLOSET

#### REVISIONS

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.
Rev:	dd/mm/yyyy	Description:	By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

STAMP:

LICENSED PROFESSIONAL ENGINEER  
 PROFESSIONAL CORPORATION  
 OF  
 ONTARIO  
 2026-01-05  
 N.S. BALAN  
 100503960



49 North Street East Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:  
CHASSE RESIDENCE



115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:  
SCHEDULES

Drawn by:  
T.LESCHIED  
Approved by:  
N.BALAN  
Date:  
06/02/2025  
Job Number:  
25-0126  
Sheet No.:  
Revision No.:  
Scale:  
As Noted  
A0.2 5

# TOWNSHIP OF SOUTHGATE ZONING BY-LAW

ITEM	PROPOSED	REQUIRED
ADDRESS: 115 CHRISTIE STREET HOPEVILLE, ON ZONE: R6	1 STOREY DWELLING	
(a) LOT AREA (MINIMUM)	10.5 acres	2.0 acres
(b) LOT FRONTAGE (MINIMUM)	200m (655ft)	100m (328ft)
(c) FRONT YARD DEPTH (MINIMUM)	20m (66ft)	20m (66ft)
(d) INTERIOR SIDE YARD WIDTH (MINIMUM)	11m (38ft)	5m (16ft)
(e) EXTERIOR SIDE YARD WIDTH (MINIMUM)	175m (577ft)	10m (33ft)
(f) REAR YARD DEPTH (MINIMUM)	177m (582ft)	10m (33ft)
(g) HEIGHT (MAXIMUM)	1 storey	2 1/2 storeys

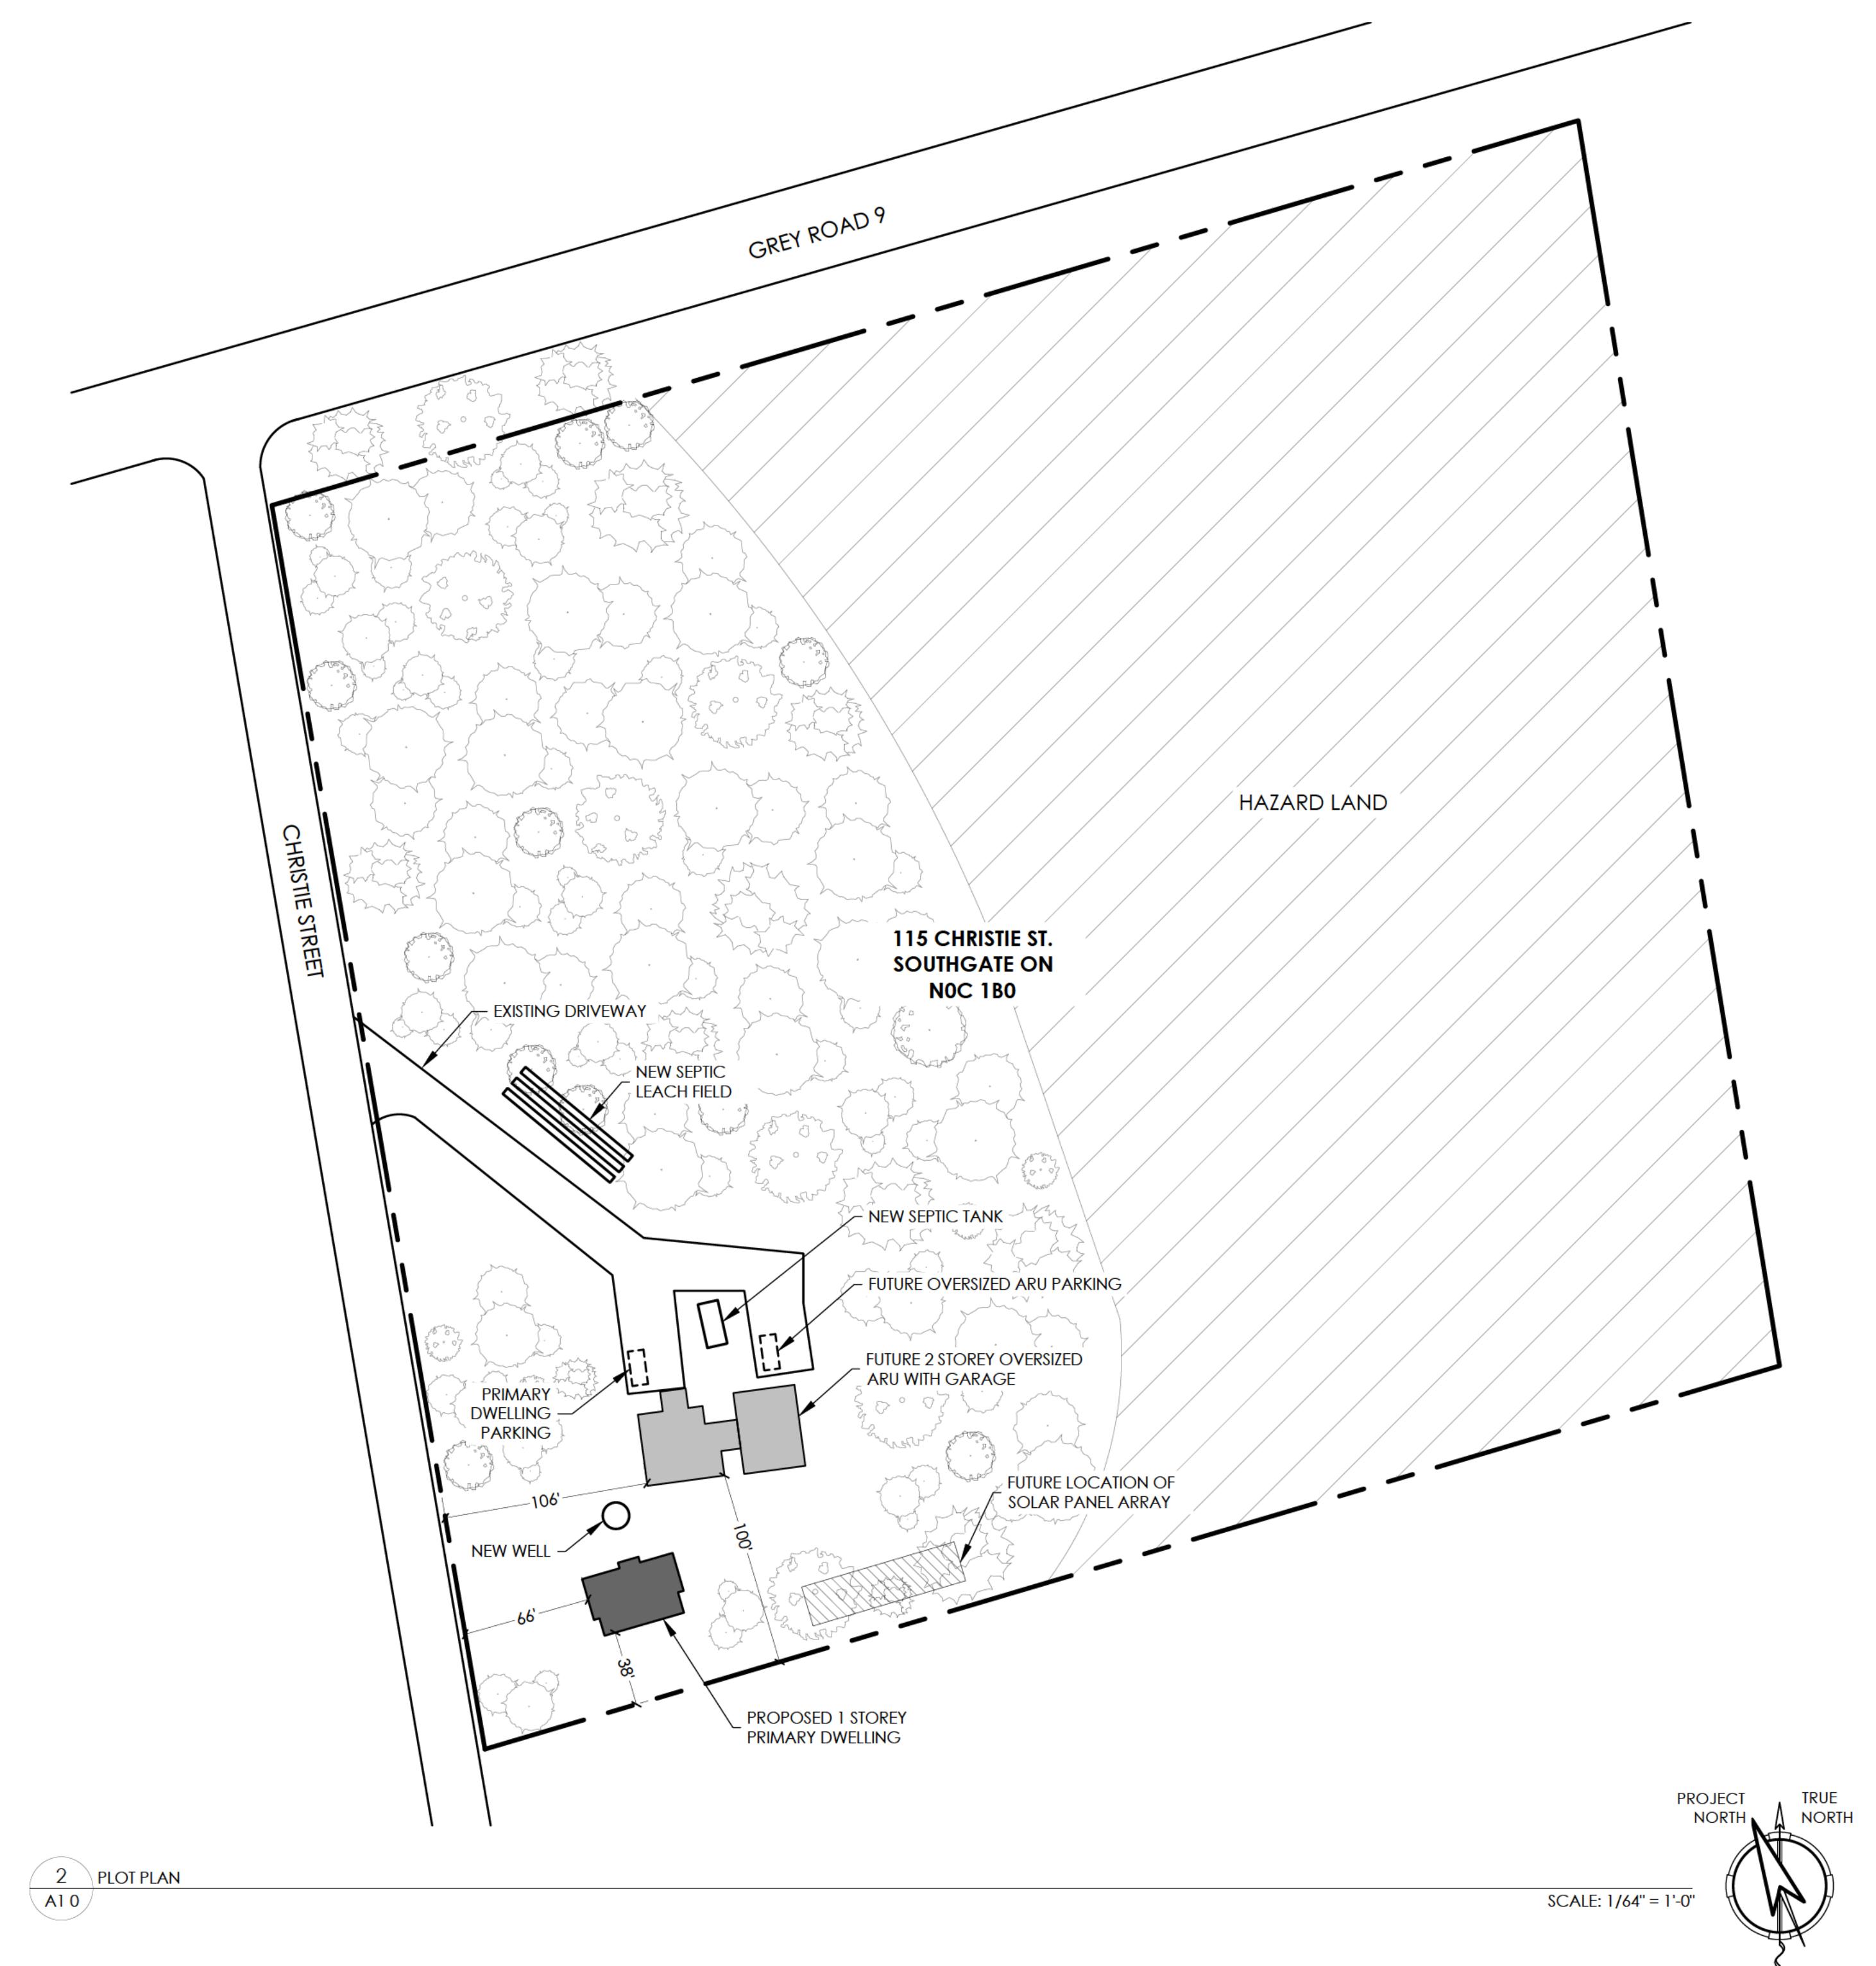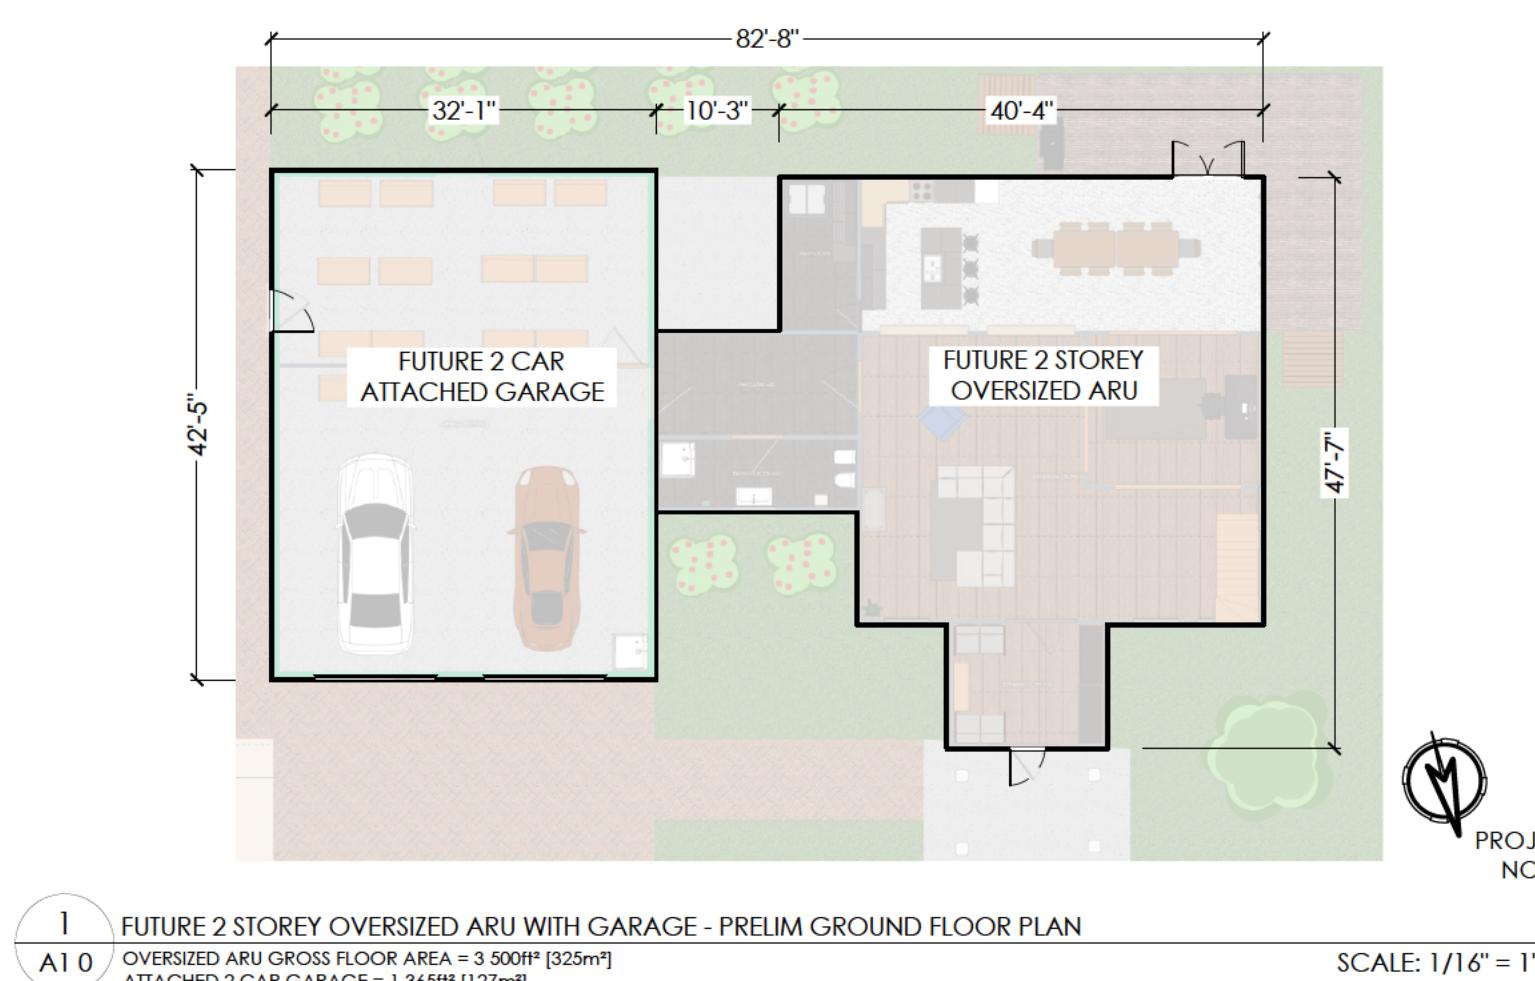

ERAL NOTE:

THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS DRAWINGS DETAILS AND SPECIFICATIONS INCLUDING WITH ARCHITECTURAL DRAWINGS AND MUST REPORT ANY DISCREPANCIES TO THE ARCHITECT AND ENGINEER BEFORE PROCEEDING WITH THE WORK

THE CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF BALAN ENGINEERING CORP. THE DRAWINGS AND SPECIFICATIONS ARE FOR THE NOTED PROJECT ONLY. ANY UNAUTHORIZED USE OF THESE DRAWINGS IN WHOLE OR IN PART WITHOUT EXPRESSED WRITTEN PERMISSION OF BALAN ENGINEERING CORP IS STRICTLY PROHIBITED

THESE DRAWINGS DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED

**DO NOT SCALE DRAWINGS**

## NOT SCALE DRAWINGS

it:  
  
JOSHUA CHASSE  
  
647 - 466 - 4569  
jc.021286@gmail.com

REVISIONS

05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
27/06/2025	ISSUED FOR PERMIT	A.K.
20/06/2025	ISSUED FOR APPROVAL	A.K.
10/03/2025	ISSUED FOR DISCUSSION	T.L.
Date:	Description:	By:
dd/mm/yyyy		

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER-IN-CHARGE.

MP:

LICENSED PROFESSIONAL ENGINEER

**2026-01-05**

**N.S. BALAN**

**100503960**

PROVINCE OF ONTARIO



49 North Street East Tillsonburg ON  
email: info@balanengineering.com  
Web: balanengineering.com



## CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

wing:

## PLOT PLAN

Own By: <b>KOZAK</b>	Job Number: <b>25-0126</b>
Approved By: <b>BALAN</b>	Sheet No. : <b>A1.0</b>
Date: <b>02/2025</b>	Revision No. : <b>5</b>
Scale: <b>As Noted</b>	

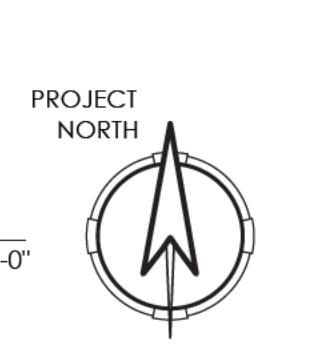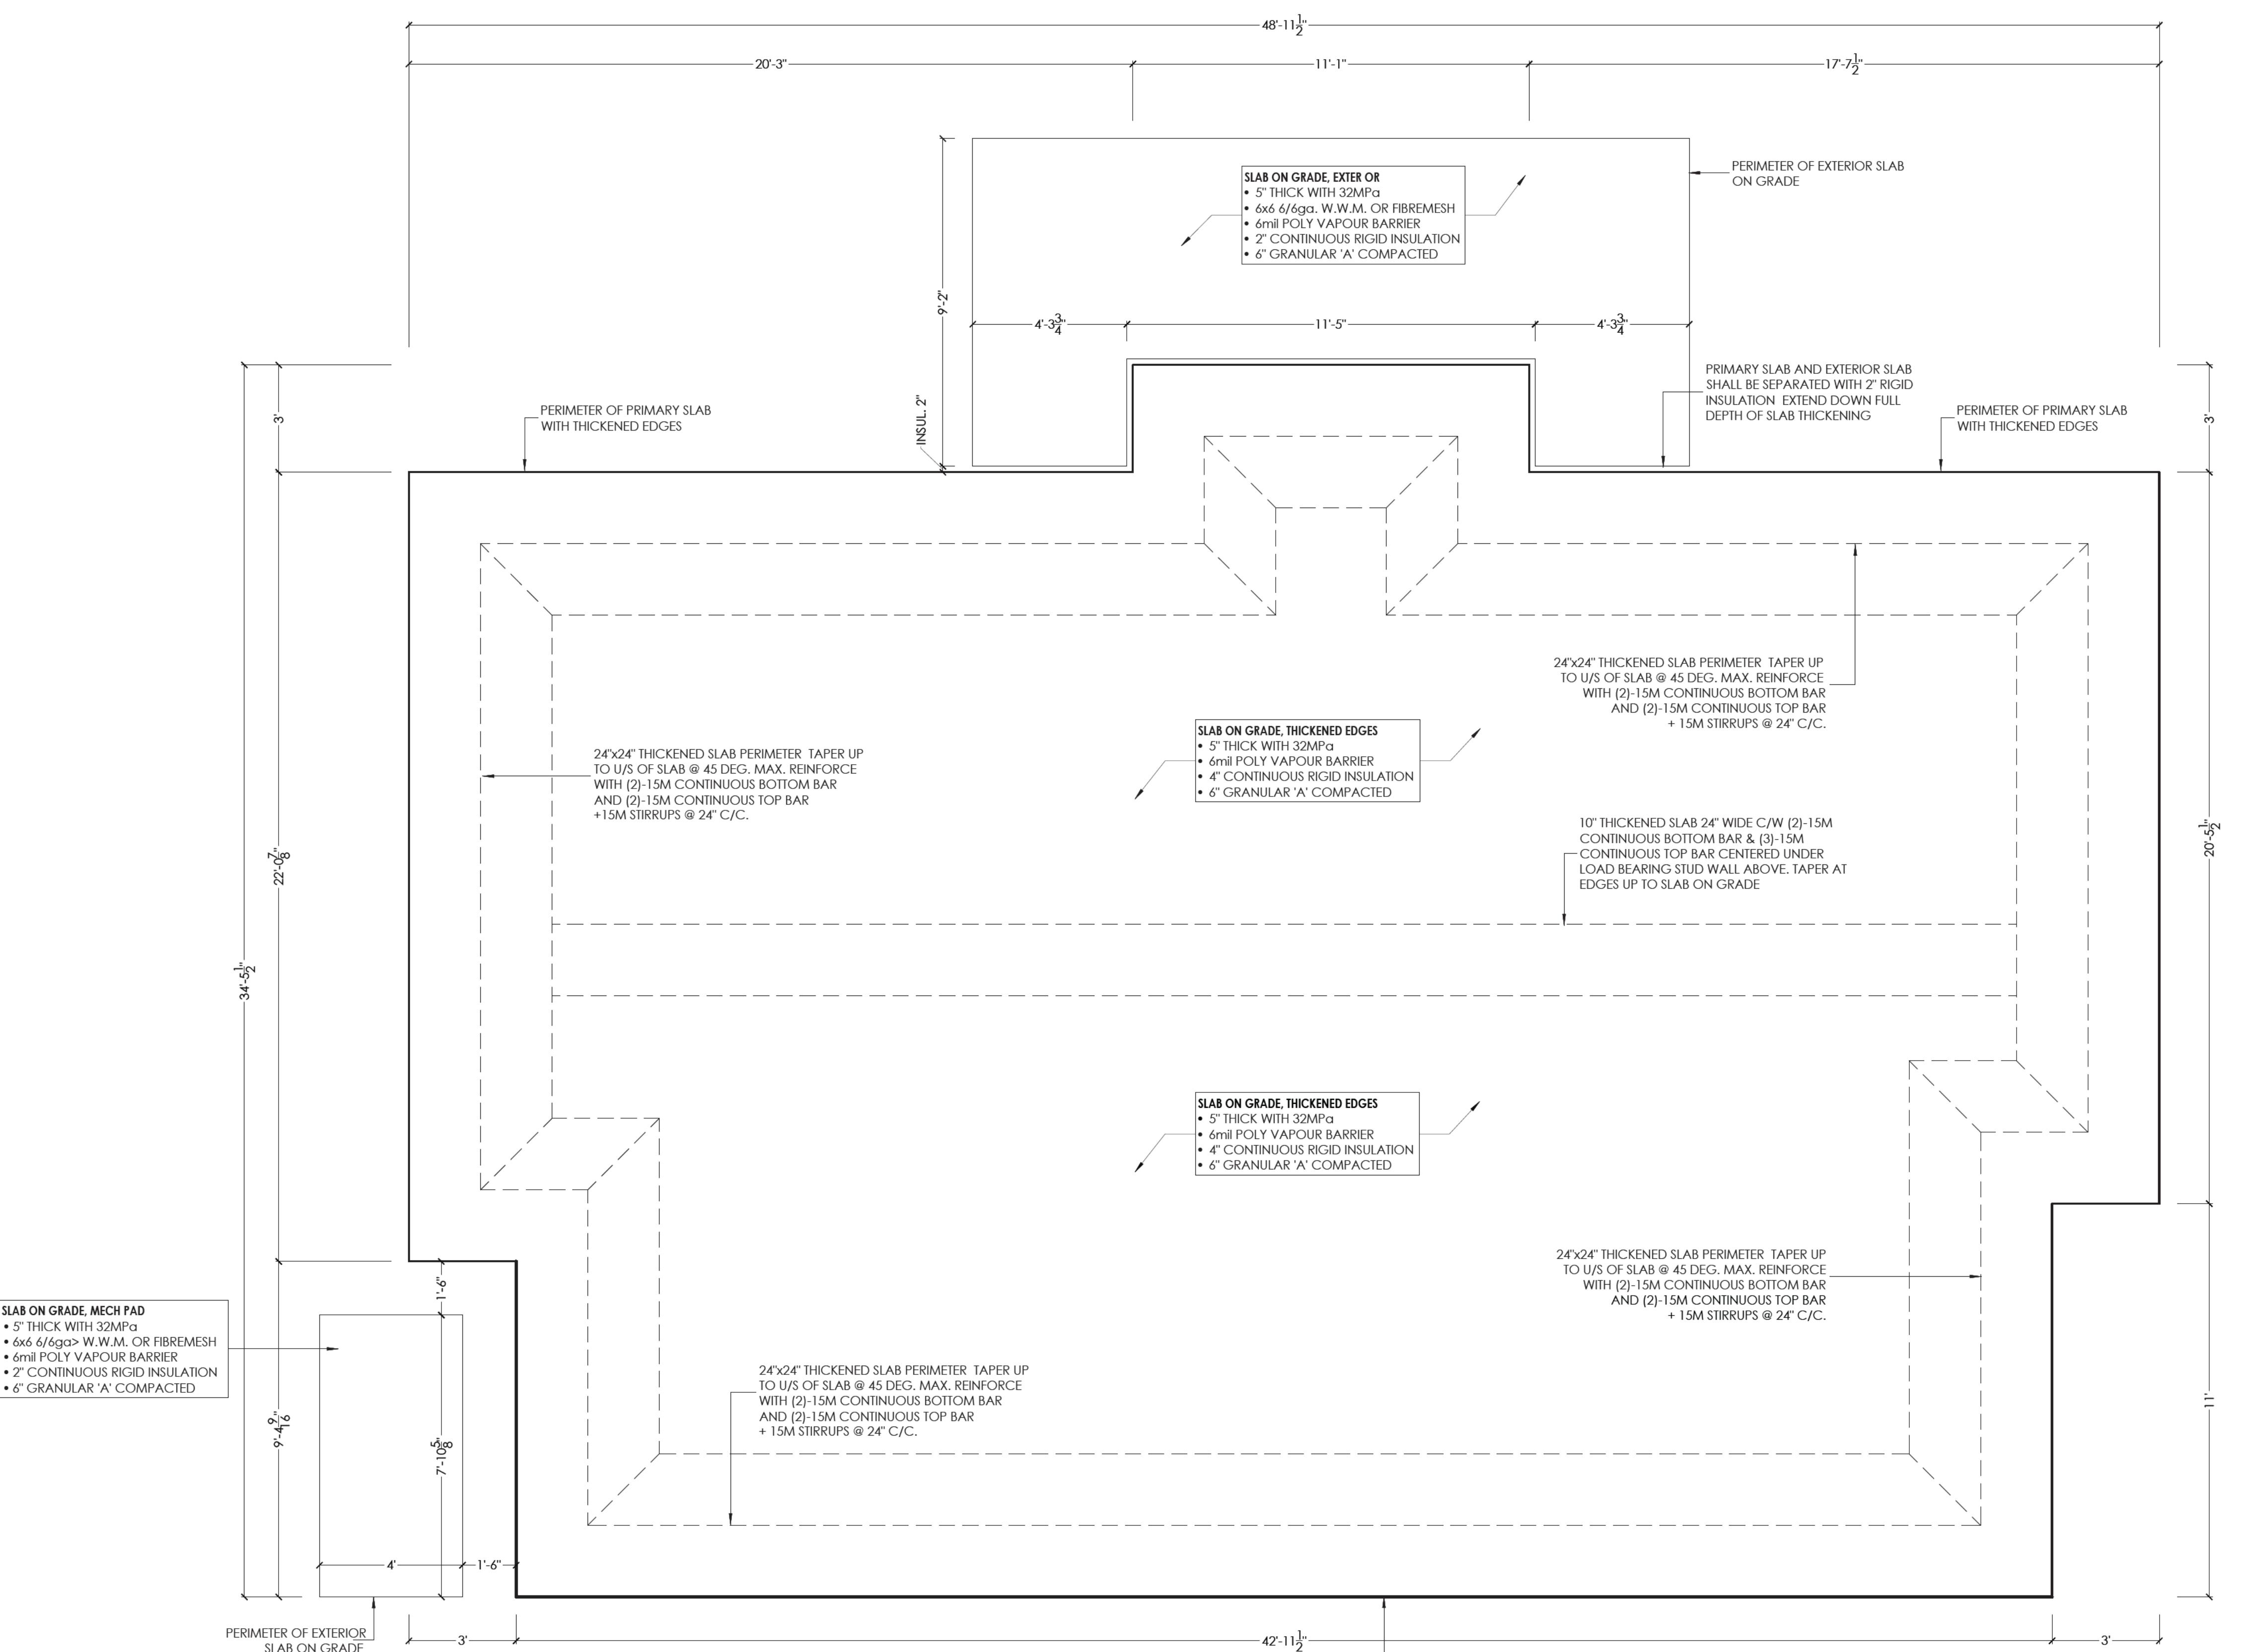

Client:

JOSHUA CHASSE

647 - 466 - 4569

jc.02128@gmail.com

REVISIONS

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.

Rev.: dd/mm/yyyy Description: By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

STAMP:



49 North Street East, Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:

CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:

FOUNDATION PLAN

Drawn by:	Job Number:
T.LESCHIED	25-0126
Approved by:	Sheet No.:
N.BALAN	Revision No.:

Date:	Scale:
06/02/2025	As Noted

A2.0 5

WALL SCHEDULE				
TAG	TYPE	WALL CORE	FULL WIDTH	
W1a	WOOD STUD	2x4 SPF STUD @ 16" C/C	0' - 4 1/2"	
W1b	WOOD STUD	2x6 SPF STUD @ 16" C/C (LOAD BEARING)	0' - 6 1/2"	
W2a	GENSTONE WALL	2x4 SPF STUD @ 24" C/C 2x6 SPF STUD @ 16" C/C	1' - 10 3/4"	
W2b	METAL SIDING WALL	2x4 SPF STUD @ 24" C/C 2x6 SPF STUD @ 16" C/C	1' - 10 1/2"	


BEAM SCHEDULE					
TAG	TYPE	ENGINEERED SPAN	JACK/KING EA. END	MIN BEARING (WxL)	BEARING POINT
BM1	3 PLY 1.75x11.875" LVL	10'-6" [3.2m]	3 JACK 2 KING	5.25" x 4.5"	THICKENED SLAB BELOW
BM2	2 PLY 2x12 SPF	4'-6" [1.3m]	2 JACK 1 KING	3" x 3"	THICKENED SLAB BELOW
BM3	3 PLY 2x12 SPF	6'-6" [2.0m]	2 JACK 2 KING	4.5" x 3"	THICKENED SLAB BELOW
BM4	3 PLY 2x12 SPF	9'-6" [2.0m]	3 JACK 2 KING	4.5" x 3"	THICKENED SLAB BELOW

WINDOW SCHEDULE				
TAG	TYPE	WIDTH	HEIGHT	SILL HEIGHT
W01	CASEMENT	2' - 6"	4' - 0"	3' - 6"
W02	SLIDING	6' - 0"	4' - 0"	3' - 6"
W03	SLIDING	4' - 0"	4' - 0"	3' - 6"
W04	FIXED	1' - 4"	4' - 0"	3' - 6"
W05	FIXED	3' - 6"	2' - 0"	8' - 6"
W06	DOUBLE CASEMENT	9' - 0"	4' - 0"	3' - 6"


DOOR SCHEDULE				
TAG	TYPE	WIDTH	HEIGHT	QTY
D01	ENTRY	3' - 8"	7' - 2"	1
D02	DOUBLE POCKET	5' - 0"	7' - 0"	1
D03	SINGLE POCKET	2' - 11"	7' - 0"	1
D04	FRENCH	5' - 0"	6' - 8"	1
D05	HINGED	3' - 0"	7' - 0"	5
D06	CLOSET	5' - 0"	7' - 0"	2
D07	CLOSET	3' - 0"	8' - 0"	1

GLAZING AREA			
ROOM	AREA (SF)	MIN. GLAZING REQUIRED (SF)	GLAZING PROPOSED (SF)
MASTER BEDROOM	118	5.9 (5%)	60.0 (50.8%)
BATHROOM	94	0.0 NOT REQ'D	10.0 (10.6%)
FOYER	108	0.0 NOT REQ'D	7.0 (6.5%)
BATHROOM	71	0.0 NOT REQ'D	5.3 (7.5%)
BEDROOM	112	5.6 (5%)	60.0 (53.6%)
STUDY	76	3.8 (5%)	16.0 (21.1%)
KITCHEN & DINNING	262	26.2 (10%)	34.4 (13.1%)
LIVING RM	243	24.3 (10%)	40.0 (16.5%)

NOTE : - NEW WINDOWS HIGHLIGHTED TO SATISFY REF 9723  
- QUANTITY'S NOTED ARE PER ROOM

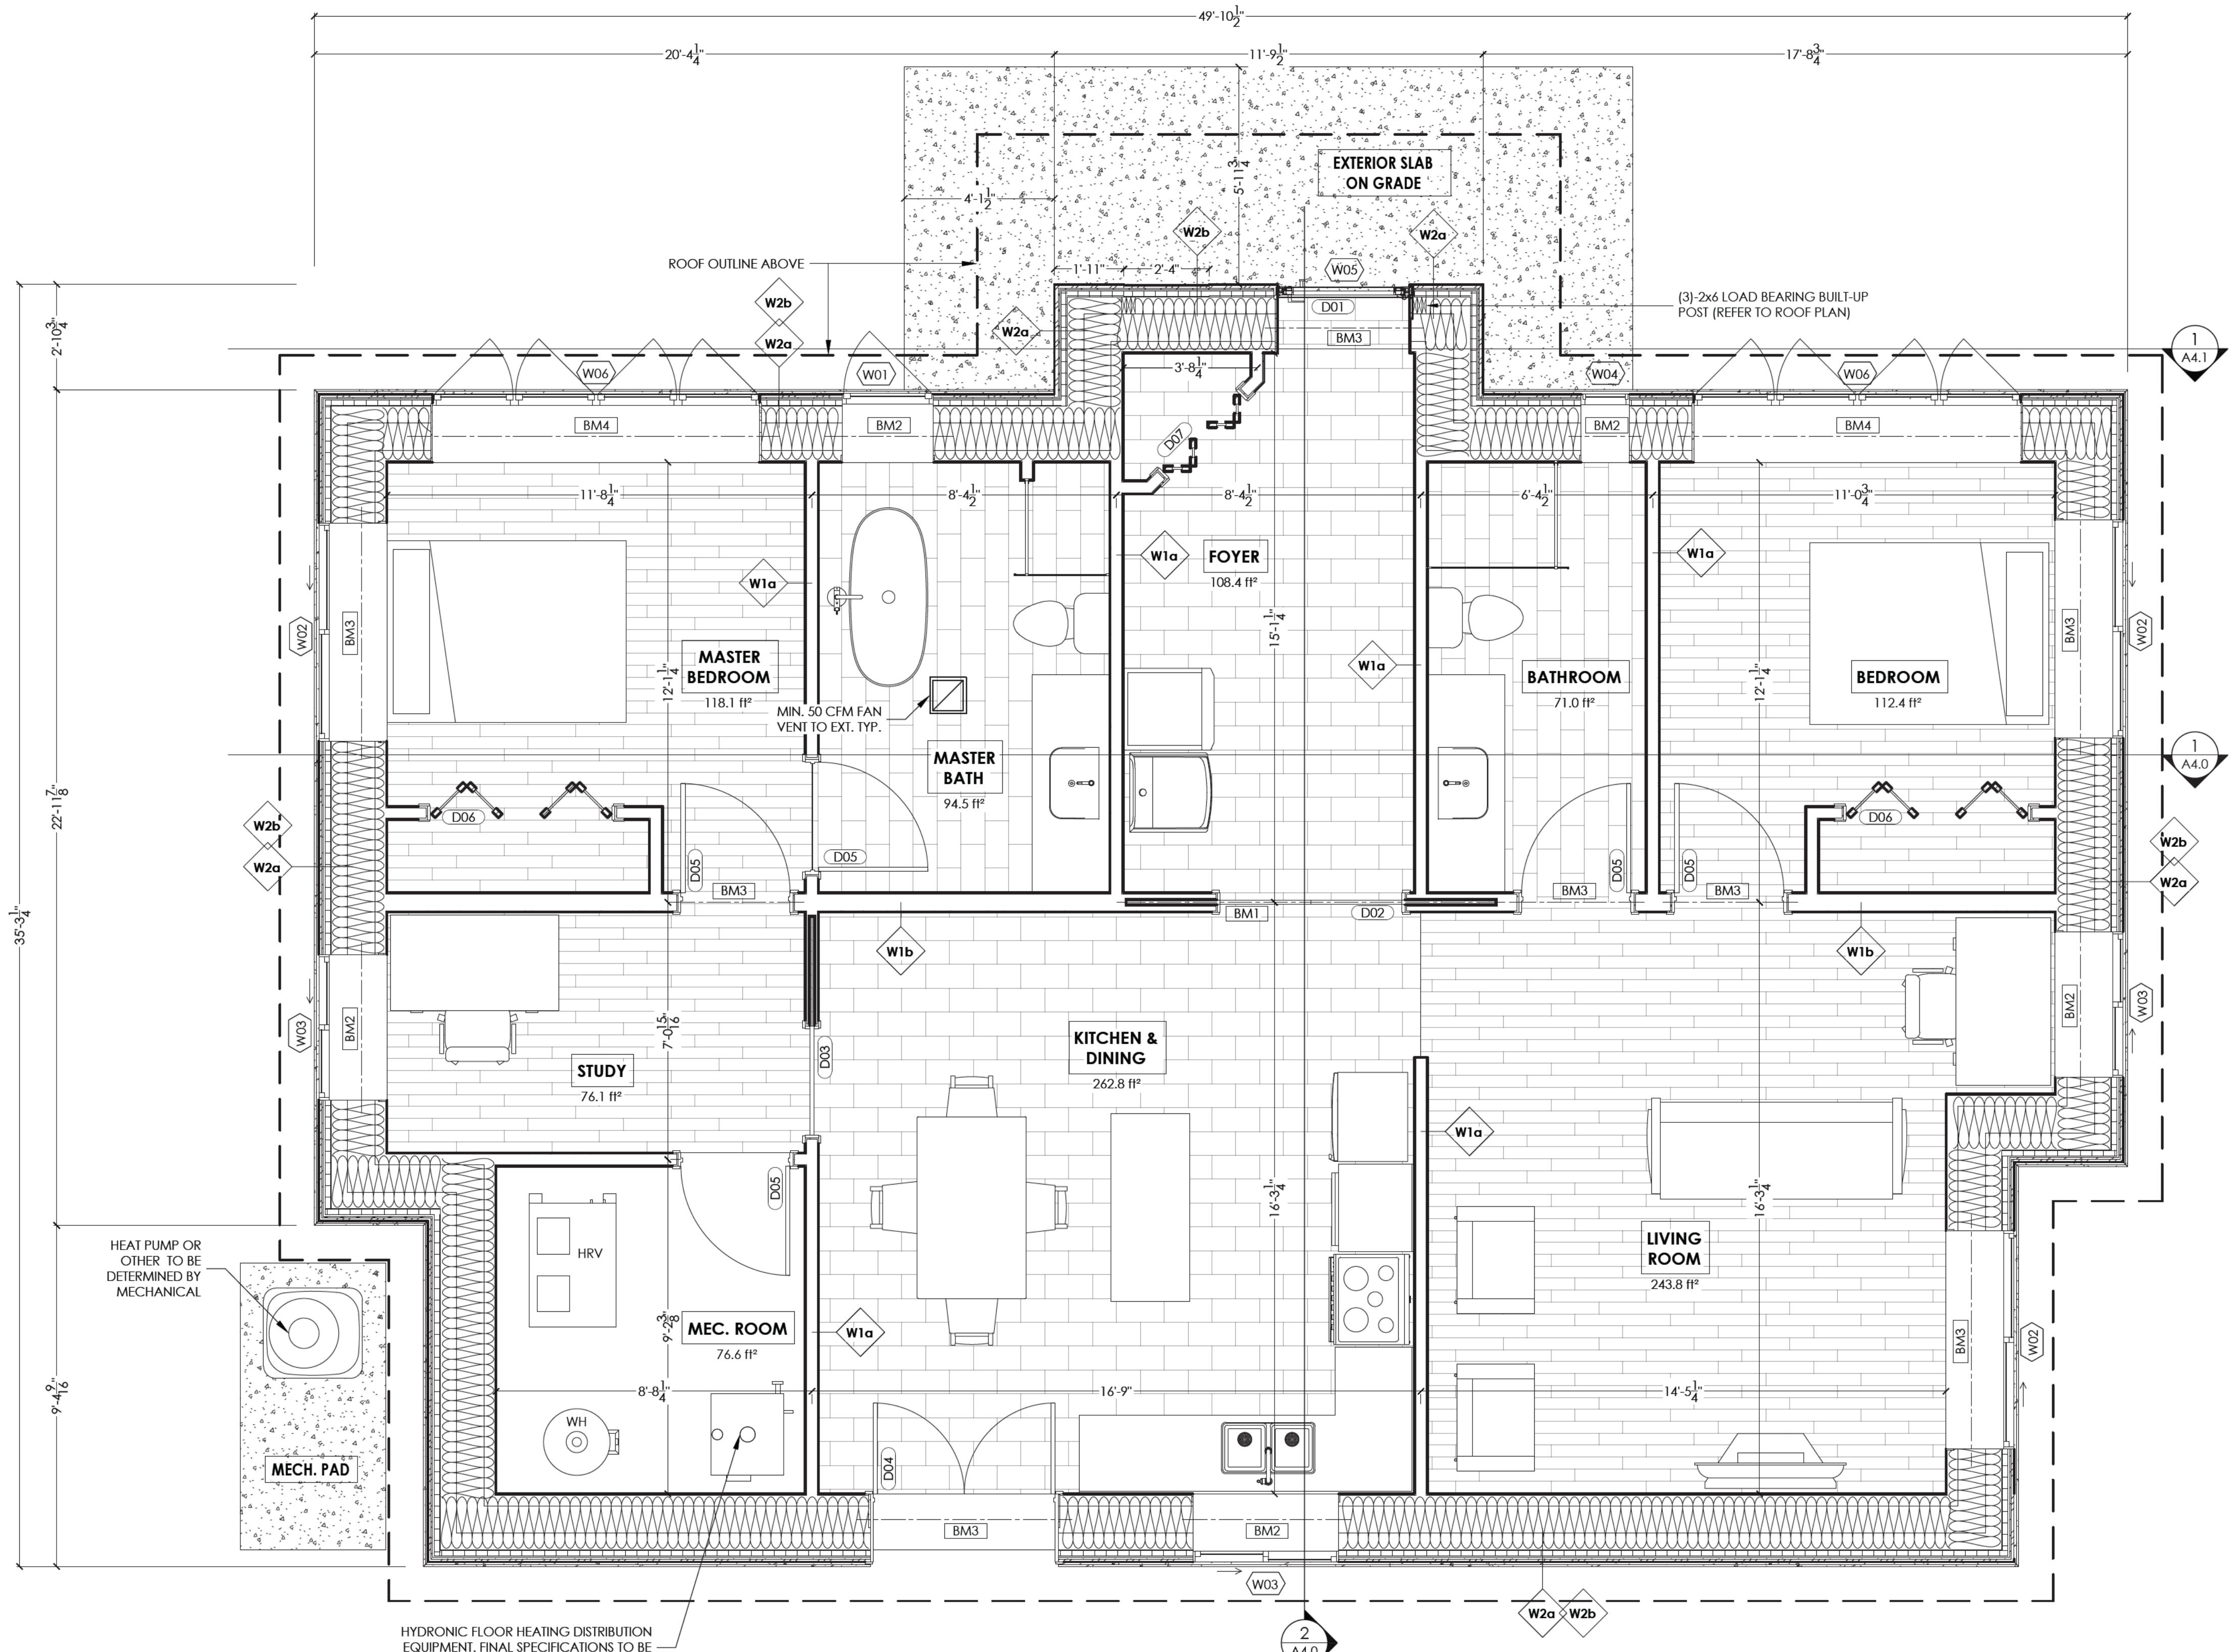



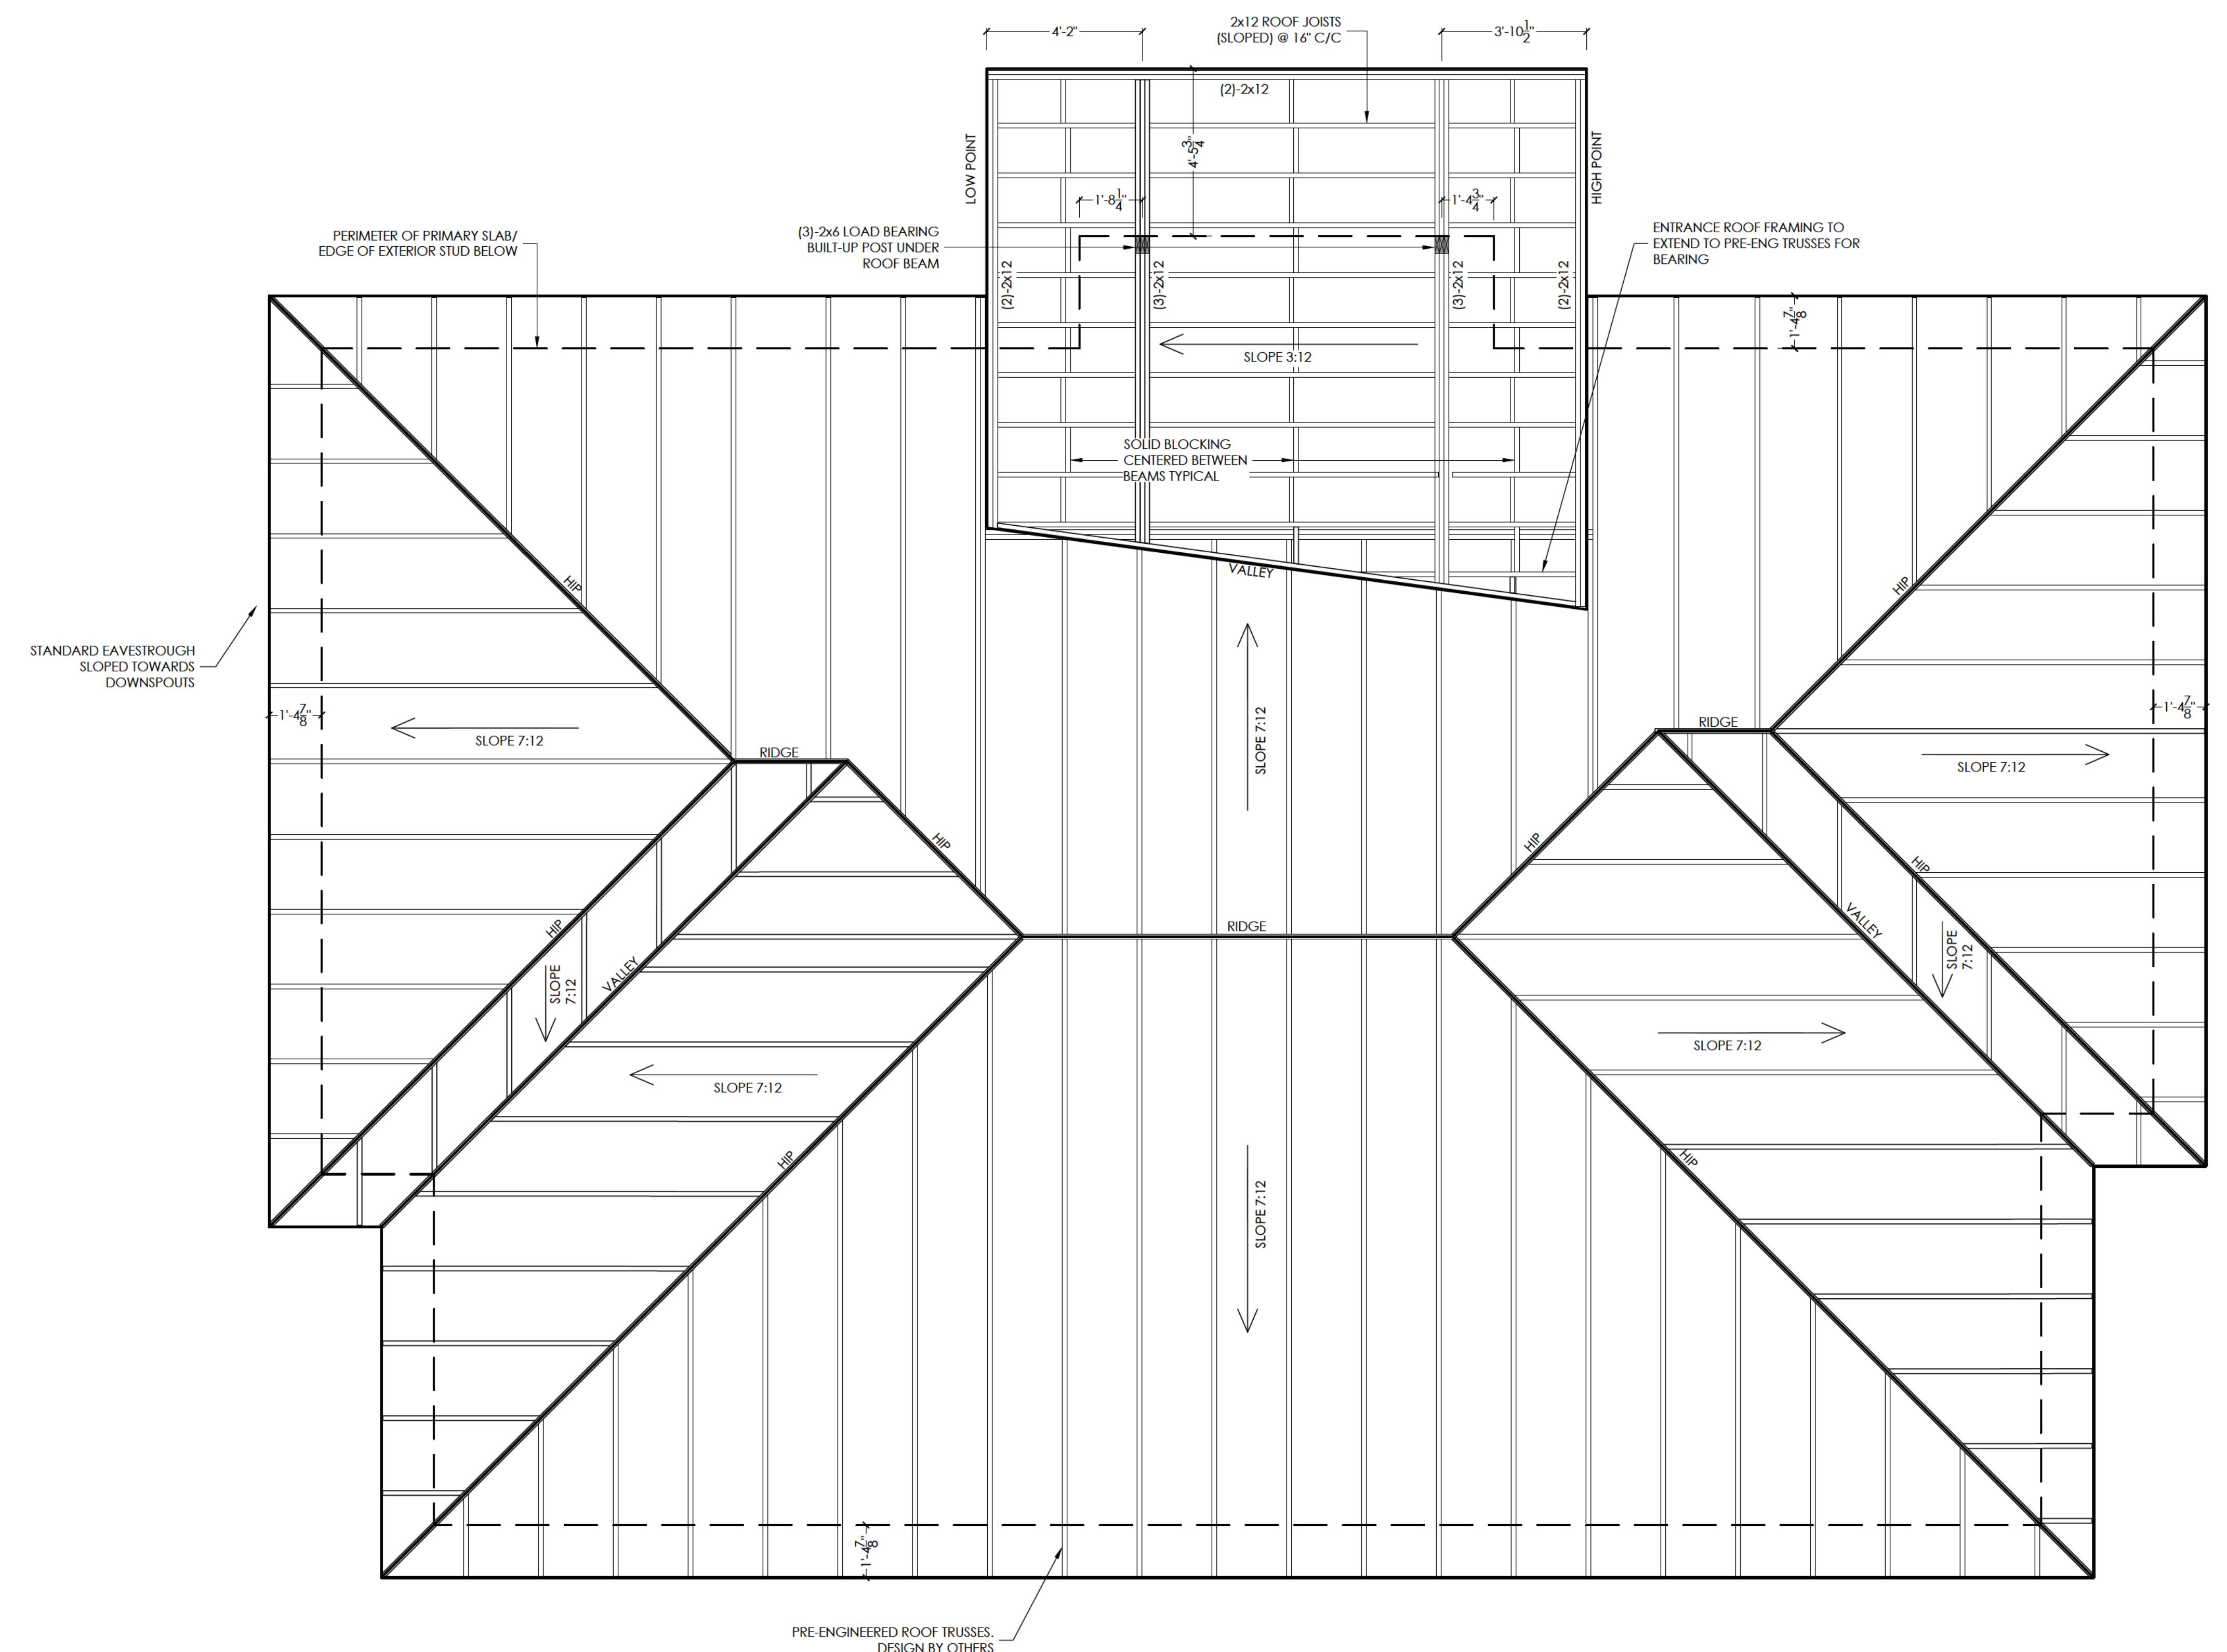


REVISIONS

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.

Rev.: dd/mm/yyyy Description: By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

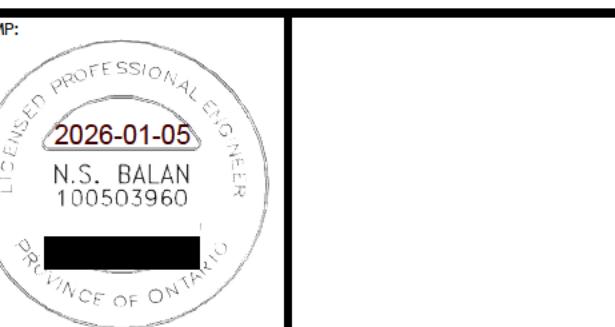

49 North Street East Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:

CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:

ROOF FRAMING PLAN

General Note:  
THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DRAWINGS, DETAILS AND SPECIFICATIONS, INCLUDING WITH ARCHITECTURAL DRAWINGS AND MUST REPORT ANY DISCREPANCIES TO THE ARCHITECT AND ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION.

THE CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF BALAN ENGINEERING CORP. THE DRAWINGS AND SPECIFICATIONS ARE FOR THE NOTED PROJECT ONLY. ANY UNAUTHORIZED USE OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN PERMISSION OF BALAN ENGINEERING CORP IS STRICTLY PROHIBITED.

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

DO NOT SCALE DRAWINGS

Client:

JOSHUA CHASSE

647 - 466 - 4569

jc.02128@gmail.com

REVISIONS

SCALE: 3/8" = 1'-0"

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.

Rev.:  
Date: dd/mm/yyyy Description: By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.



49 North Street East, Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:

CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:

BUILDING SECTIONS



Drawn by: T.LESCHIED Job Number: 25-0126


Approved by: N.BALAN Sheet No.: Revision No.:

Date: 06/02/2025 Scale: As Noted

Scale: A4.0 5

SCALE: 3/8" = 1'-0"

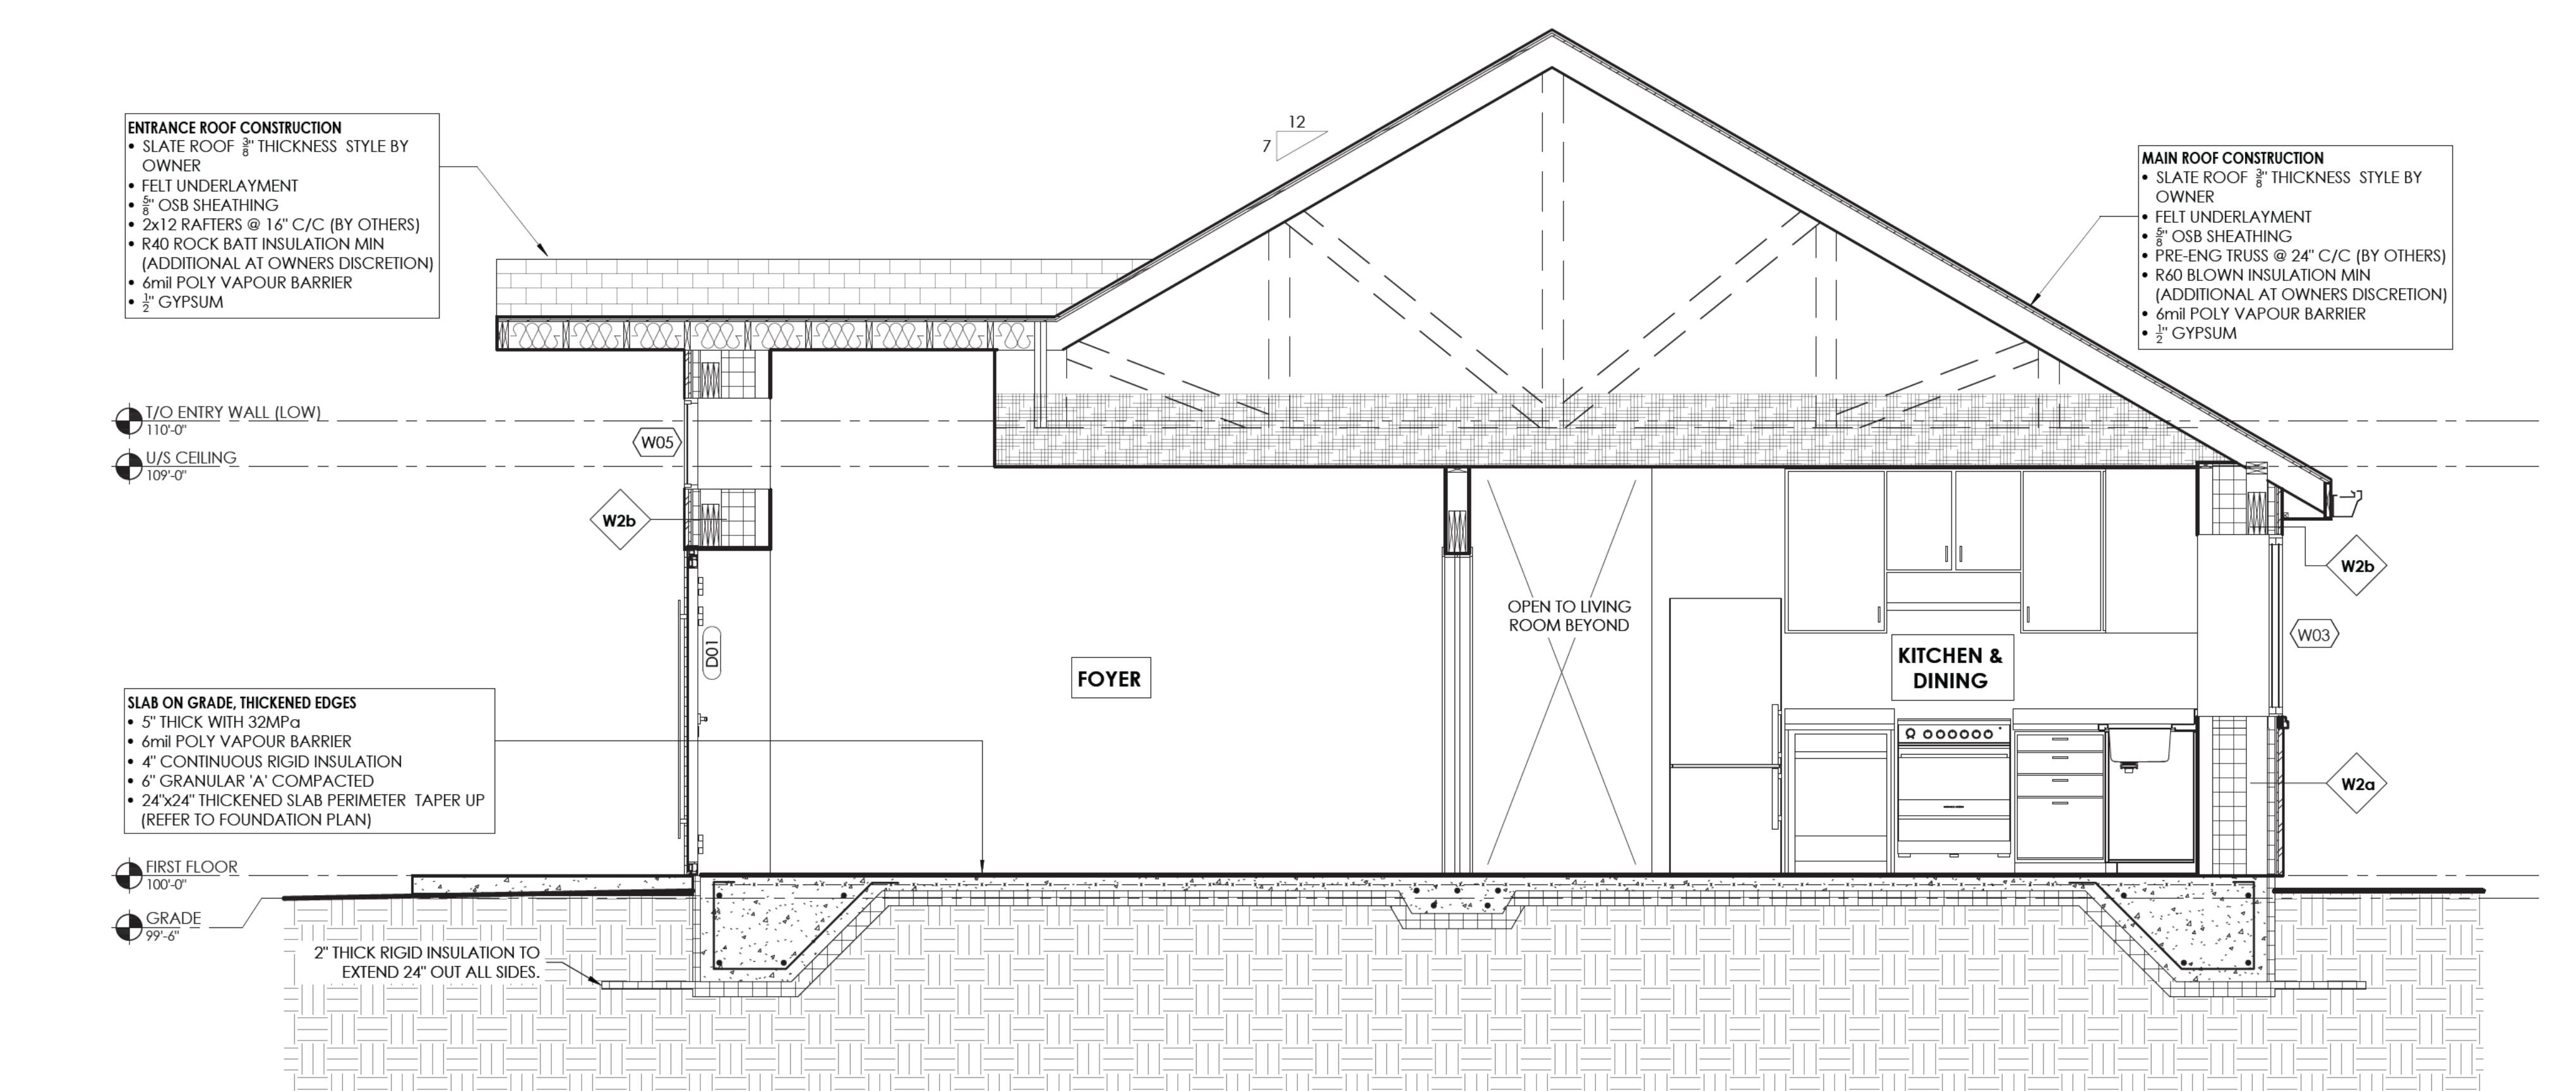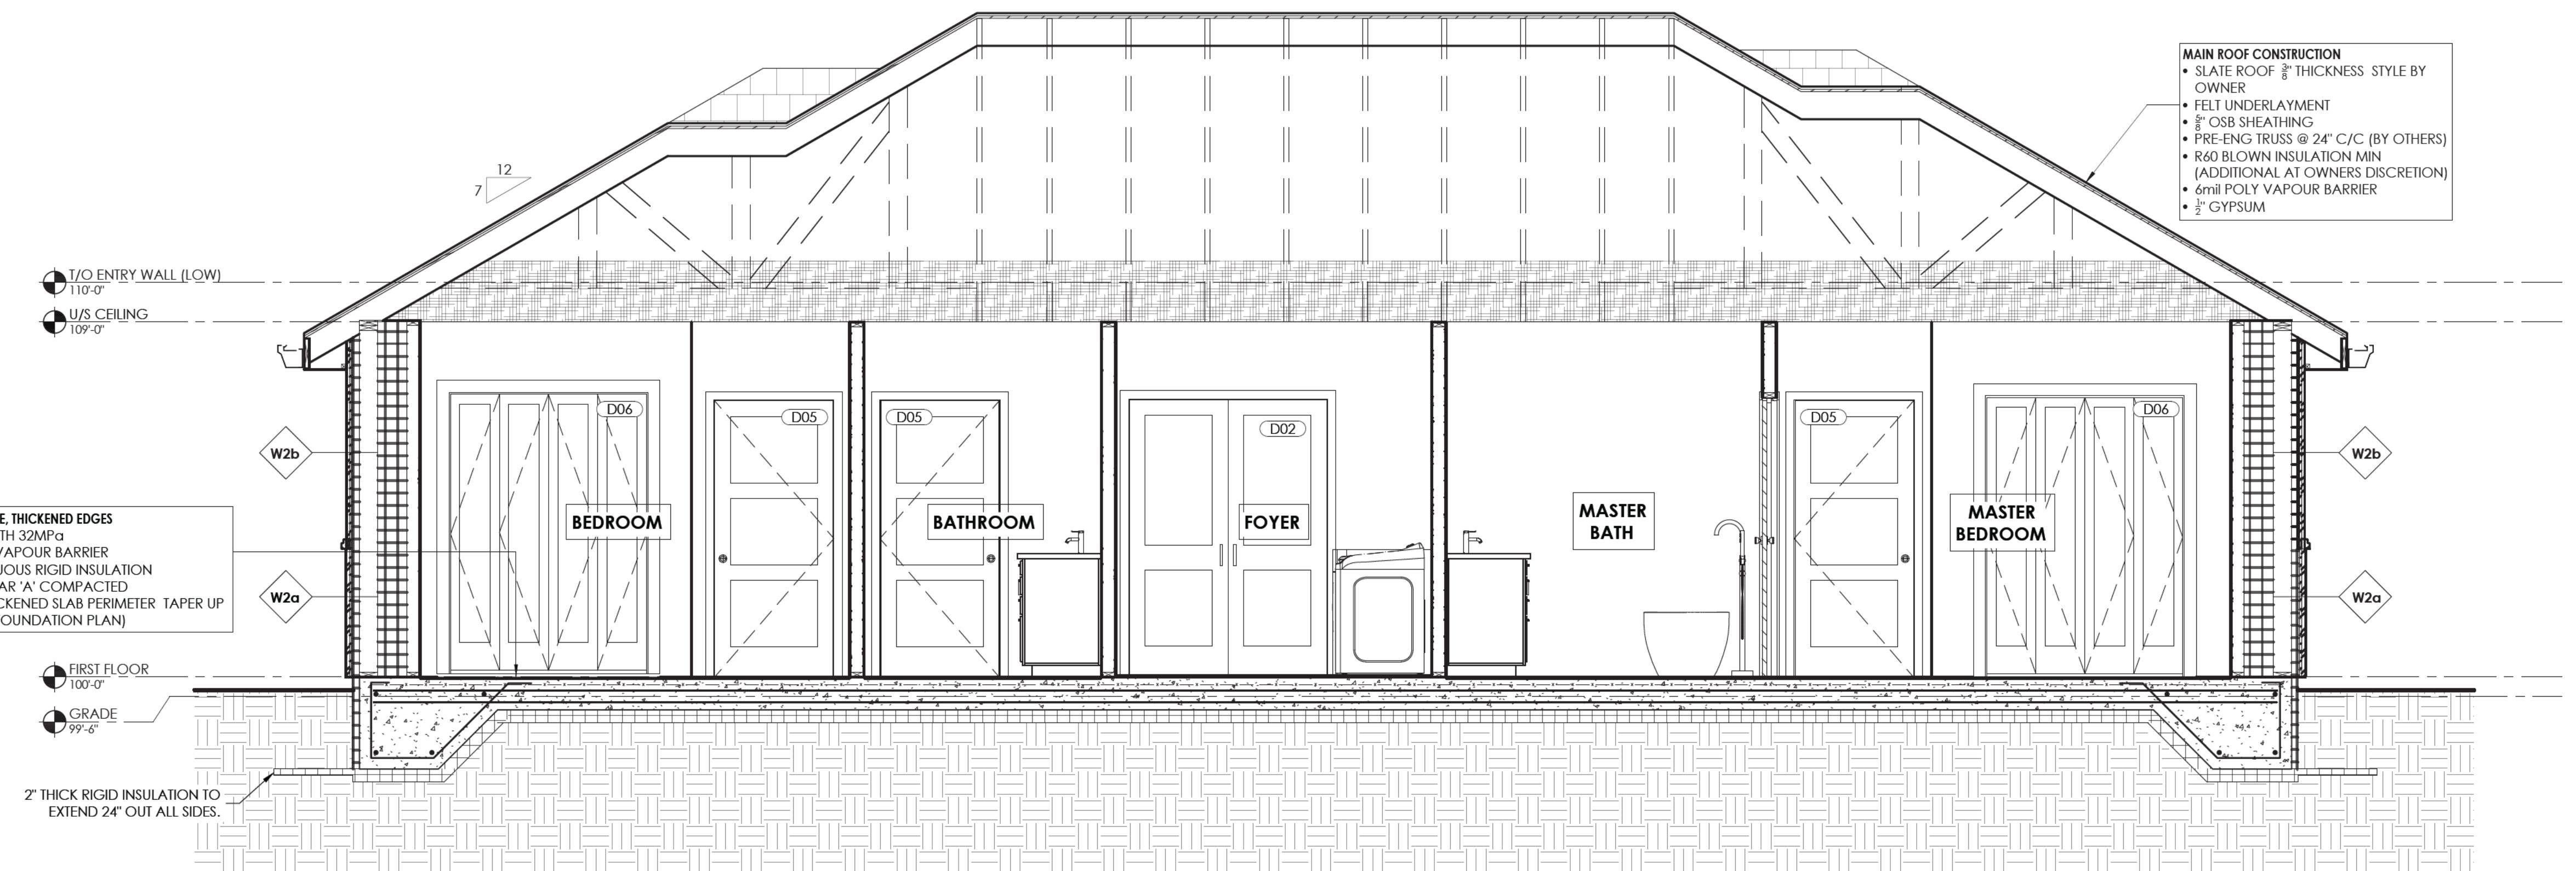

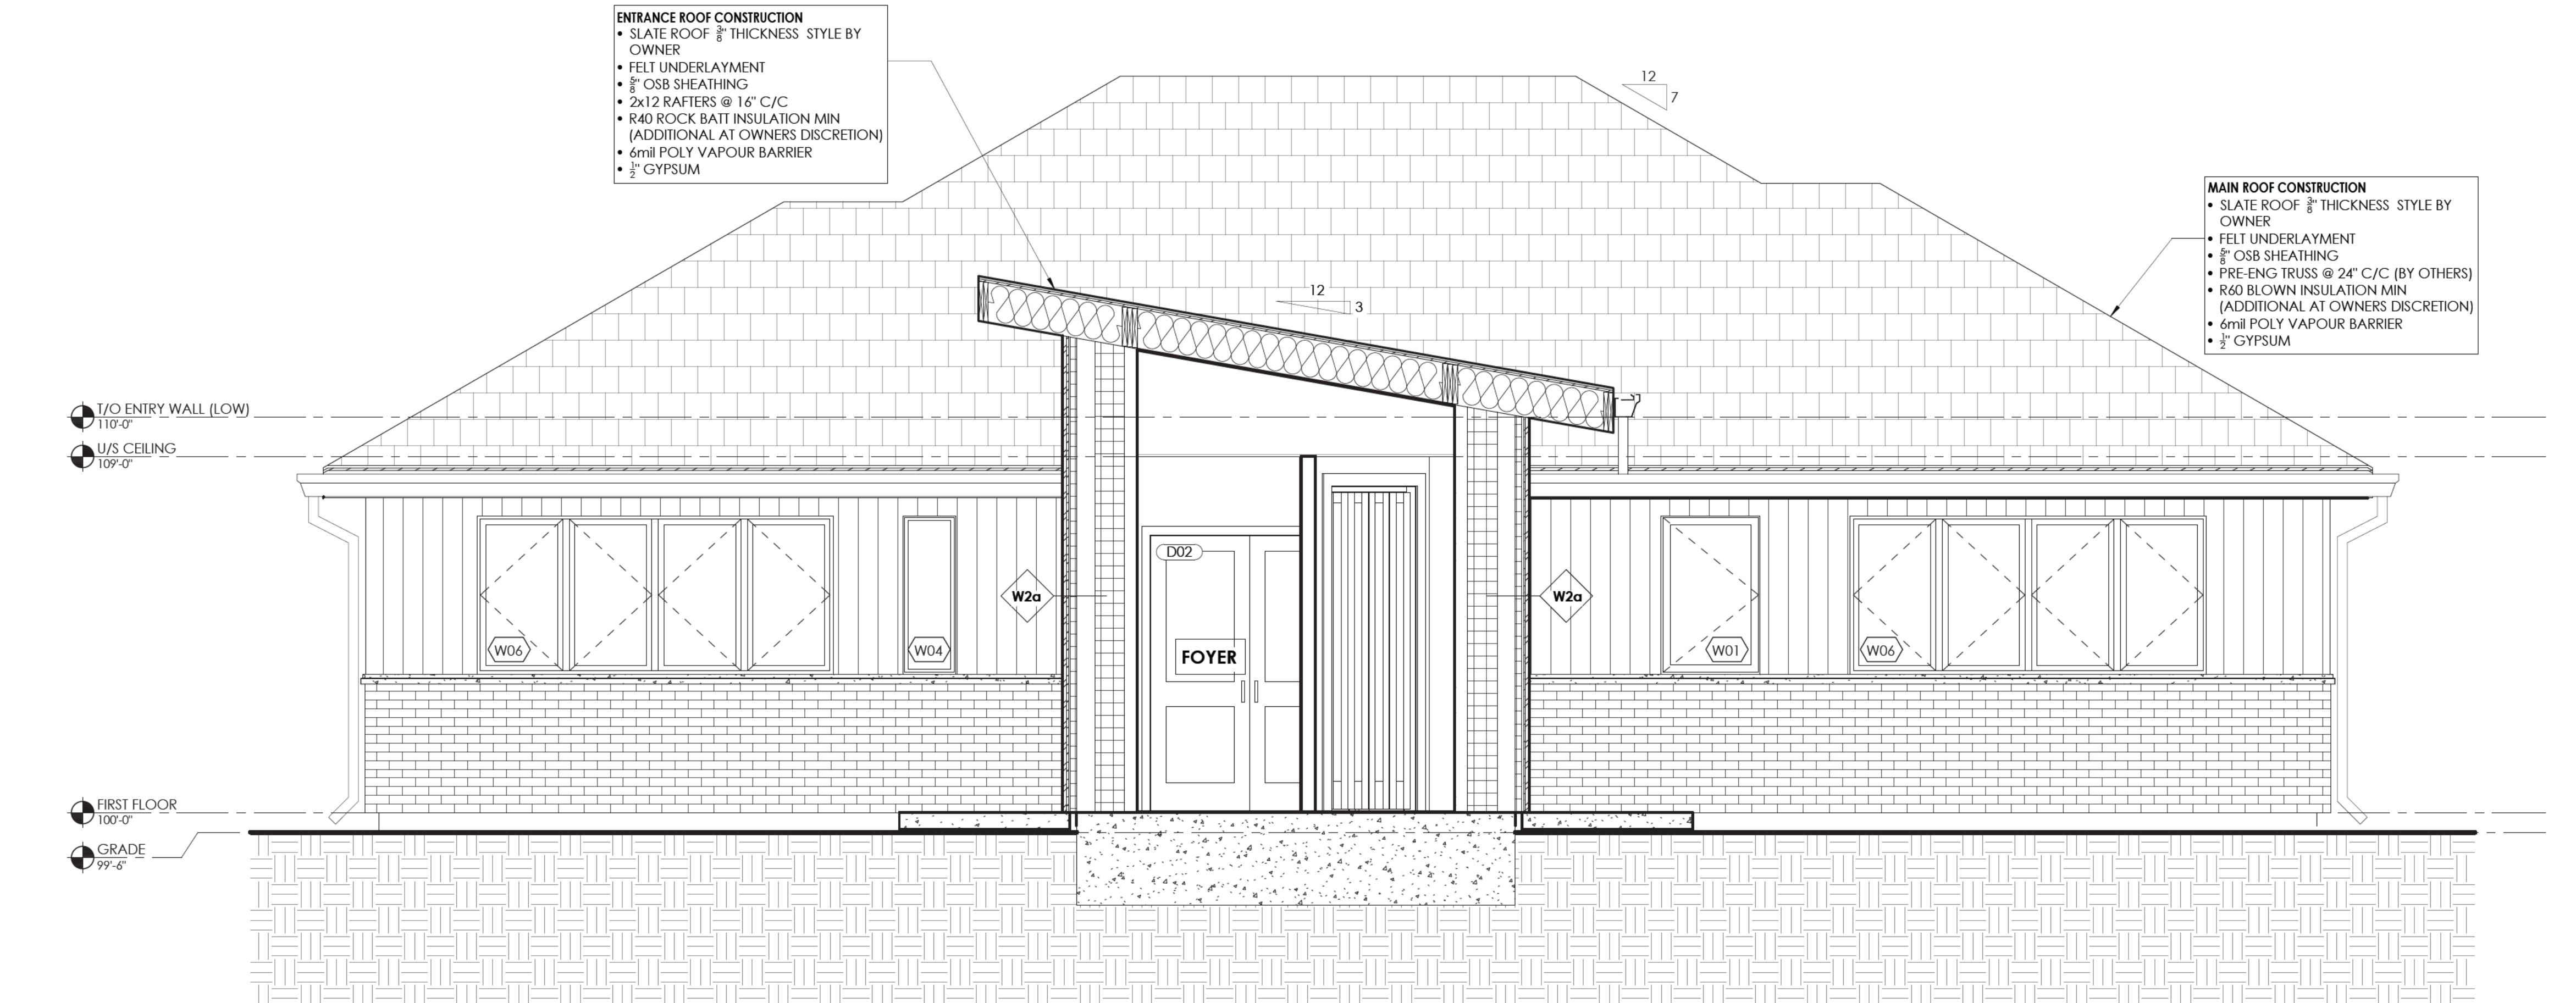

1  
A4.1  
BUILDING SECTION

Client:  
**JOSHUA CHASSE**  
647 - 466 - 4569  
jc.021286@gmail.com

REVISIONS

SCALE: 3/8" = 1'-0"

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.
Rev:	Date:	dd/mm/yyyy	Description:
			By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED



49 North Street East Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:

CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:

BUILDING SECTIONS

Drawn by: T.LESCHIED Job Number: 25-0126

Approved by: N.BALAN Sheet No.: Revision No.:

Date: 06/02/2025 Scale: As Noted

**A4.1** 5

General Note:  
THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DRAWINGS, DETAILS AND SPECIFICATIONS, INCLUDING WITH ARCHITECTURAL DRAWINGS AND MUST REPORT ANY DISCREPANCIES TO THE ARCHITECT AND ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION.

THE CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF BALAN ENGINEERING CORP. THE DRAWINGS AND SPECIFICATIONS ARE FOR THE NOTED PROJECT ONLY. ANY UNAUTHORIZED USE OF THESE DRAWINGS AND SPECIFICATIONS IS PROHIBITED. WRITTEN PERMISSION OF BALAN ENGINEERING CORP IS STRICTLY PROHIBITED.

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.


DO NOT SCALE DRAWINGS

General Note:  
THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DRAWINGS, DETAILS AND SPECIFICATIONS, INCLUDING WITH ARCHITECTURAL DRAWINGS AND MUST REPORT ANY DISCREPANCIES TO THE ARCHITECT AND ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION.


THE CONTENTS OF THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF BALAN ENGINEERING CORP. THE DRAWINGS AND SPECIFICATIONS ARE FOR THE NOTED PROJECT ONLY. ANY UNAUTHORIZED USE OF THESE DRAWINGS AND SPECIFICATIONS IS PROHIBITED. WRITTEN PERMISSION OF BALAN ENGINEERING CORP IS STRICTLY PROHIBITED.

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.


DO NOT SCALE DRAWINGS

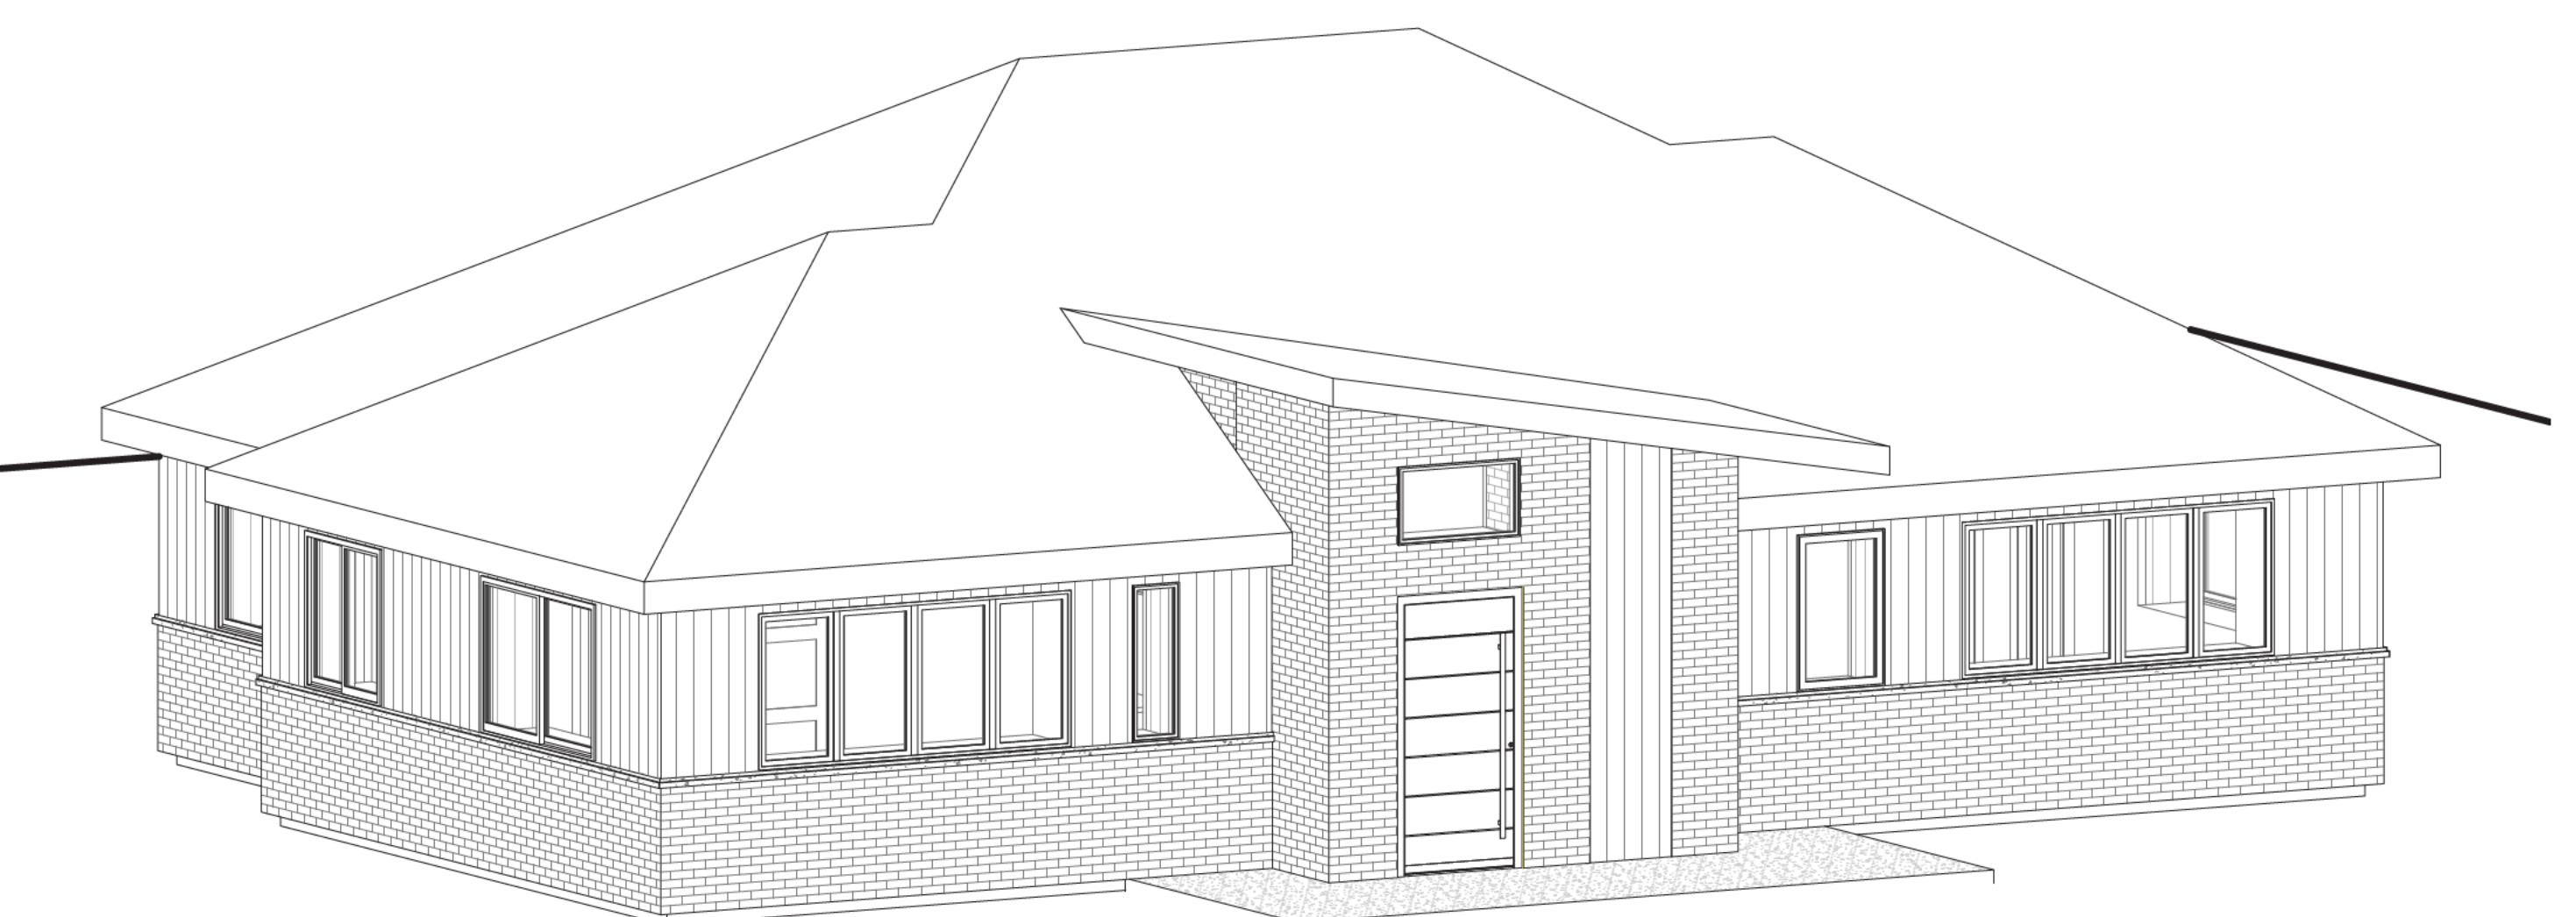


1 3D NORTH ELEVATION  
A4.2

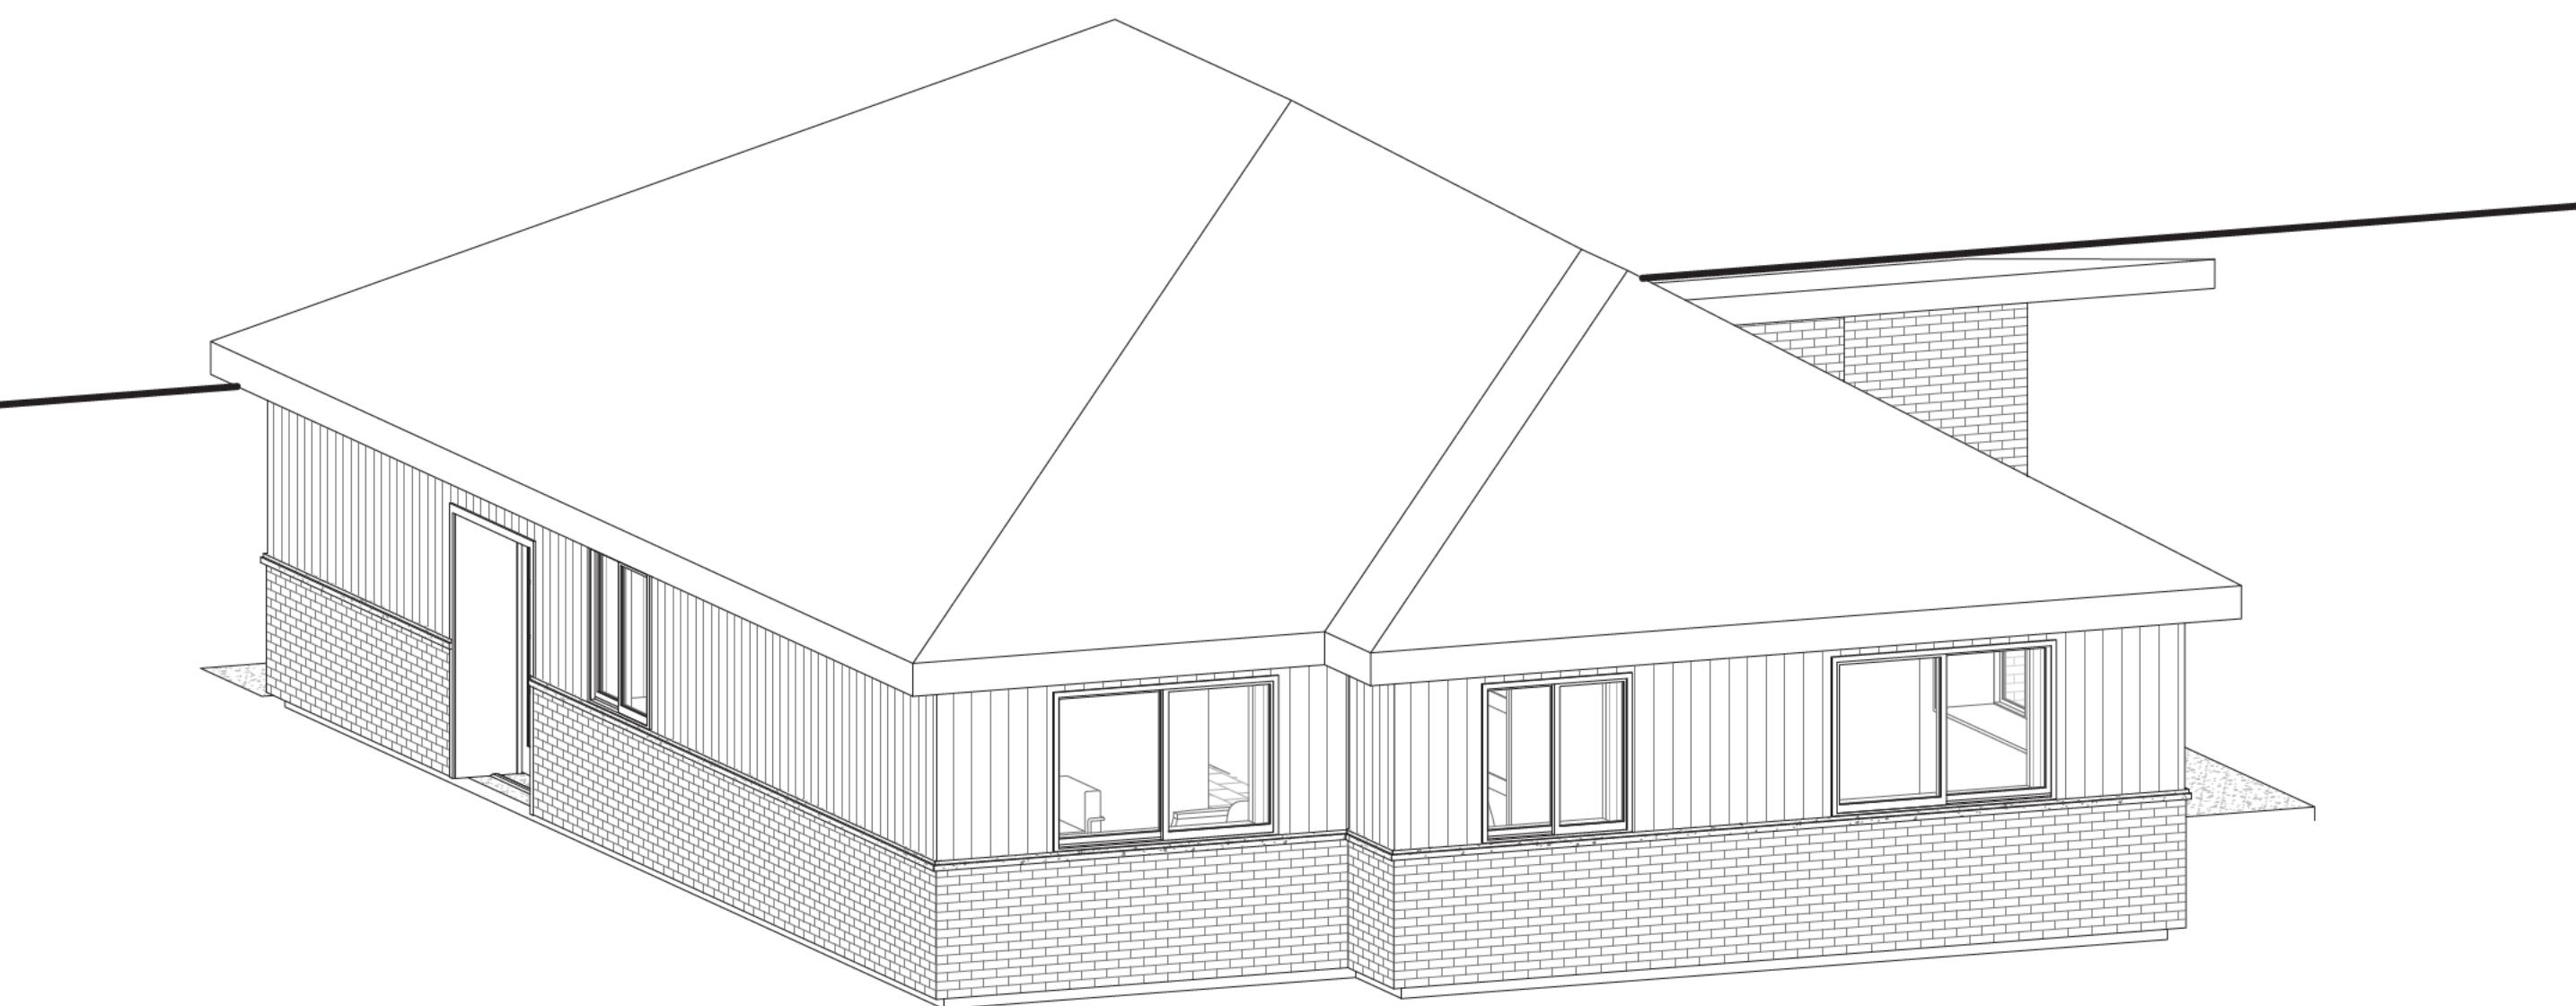

1 3D EAST ELEVATION  
A4.2

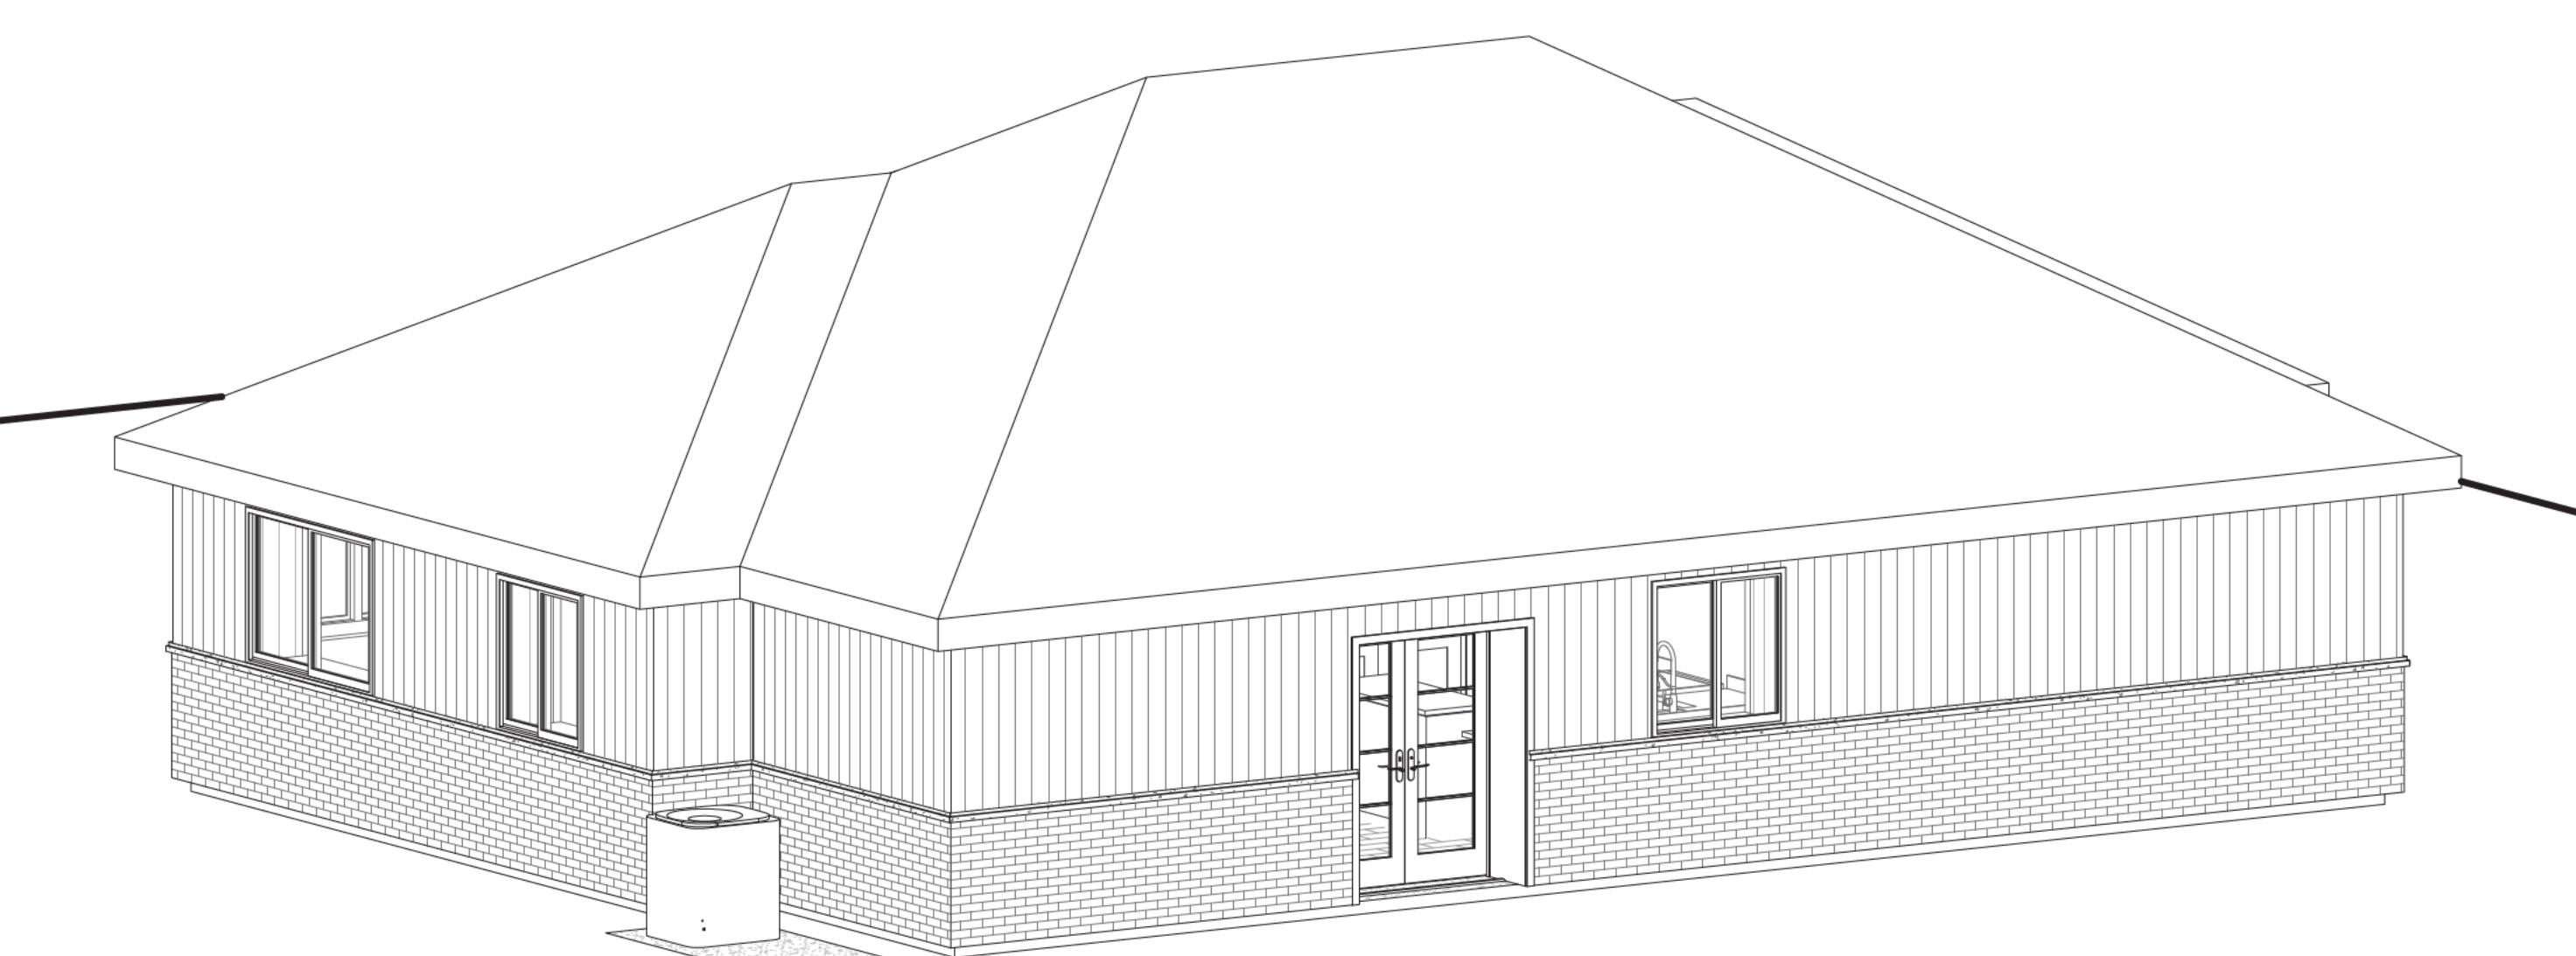

1 3D SOUTH ELEVATION  
A4.2

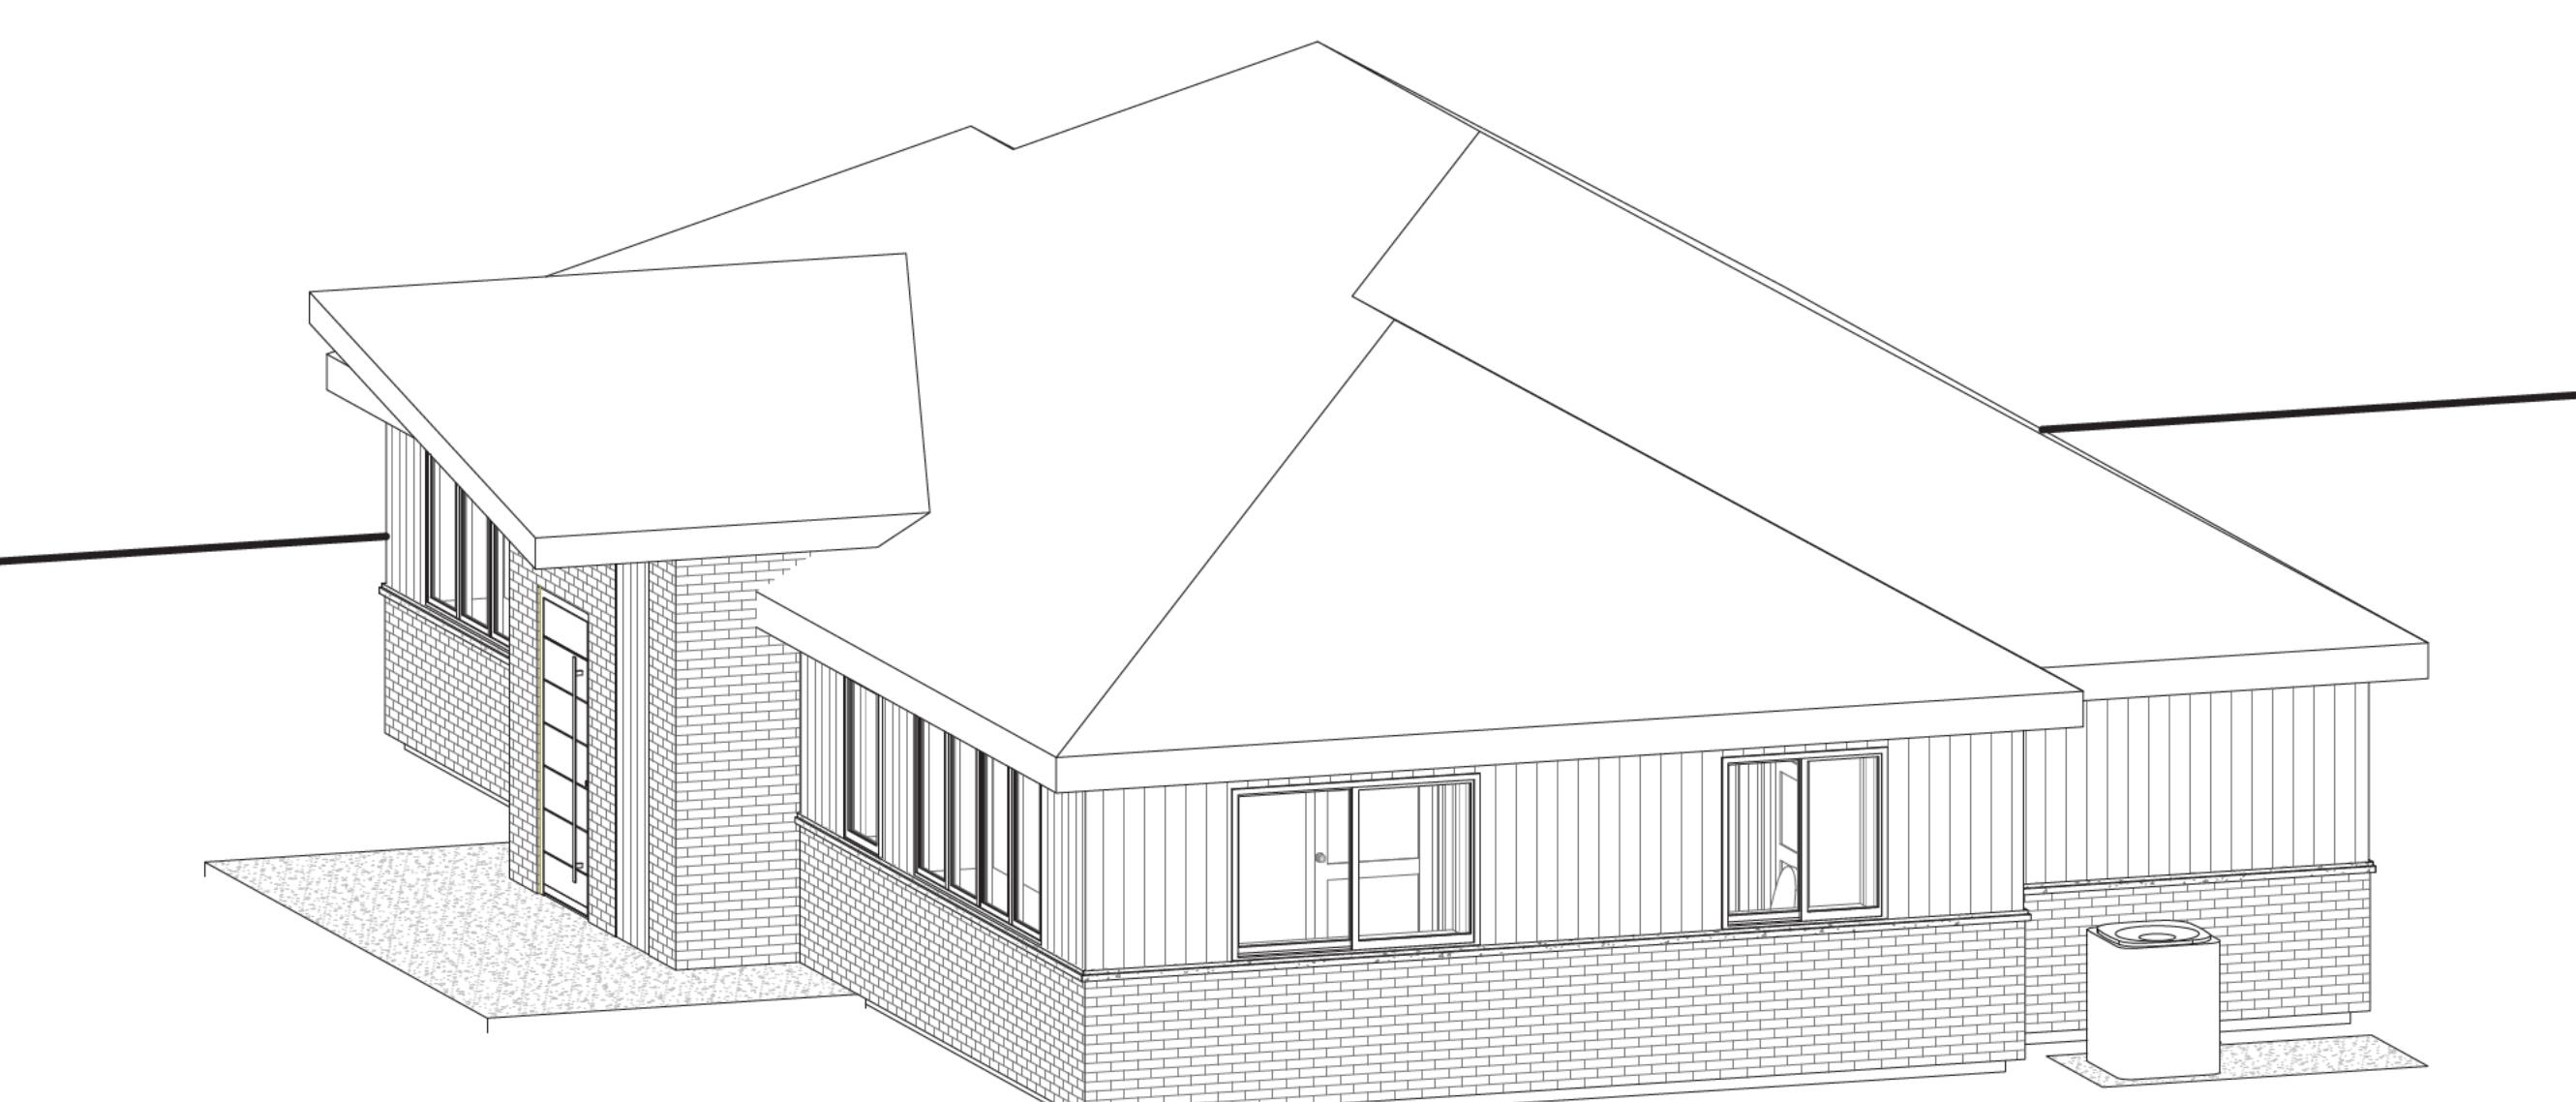

1 3D WEST ELEVATION  
A4.2


Client:  
**JOSHUA CHASSE**  
647 - 466 - 4569  
jc.02128@gmail.com

REVISIONS

5	05/01/2026	RE-ISSUED FOR MINOR VARIANCE	A.K.
4	20/10/2025	RE-ISSUED FOR MINOR VARIANCE	A.K.
3	27/06/2025	ISSUED FOR PERMIT	A.K.
2	20/04/2025	ISSUED FOR APPROVAL	A.K.
1	10/03/2025	ISSUED FOR DISCUSSION	T.L.

Rev.: Date: dd/mm/yyyy Description: By:

THESE DRAWINGS, DETAILS AND SPECIFICATIONS SHALL NOT BE USED FOR CONSTRUCTION UNTIL THEY HAVE BEEN SIGNED AND SEALED BY THE ENGINEER AND A BUILDING PERMIT HAS BEEN ISSUED.

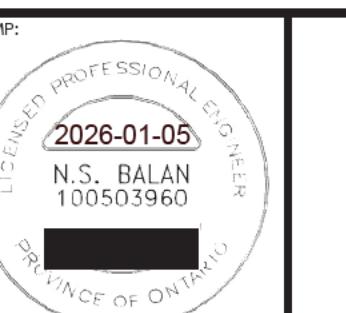

**BALAN**  
ENGINEERING CORP.

49 North Street East, Tillsonburg, ON  
Email: info@balanengineering.com  
Web: balanengineering.com  
Office: 519 688 2325

Project Name:

CHASSE RESIDENCE

115 CHRISTIE STREET, HOPEVILLE, ONTARIO

Drawing:

3D ELEVATIONS

Drawn by: T.LESCHIED	Job Number: 25-0126
Approved by: N.BALAN	Sheet No.: Revision No.:
Date: 06/02/2025	Scale: As Noted
A4.2 5	